



Technical Standards for Subsurface Sewage Disposal Systems

Effective August 17, 2026

State of Connecticut
Department of Public Health
Environmental Engineering Program
410 Capitol Avenue - MS #12SEW
P.O. Box 340308
Hartford, Connecticut 06134

Email: DPH.EnvironEng@ct.gov

www.ct.gov/dph/subsurfacesewage

TABLE OF CONTENTS

1.	SCOPE, USAGE GUIDE AND FORMATTING OVERVIEW	4
2.	ACRONYMS AND ABBREVIATIONS.....	5
3.	SUBSURFACE SEWAGE ENFORCEMENT OFFICER	6
4.	DEFINITIONS	6
5.	LOCATION OF SEWAGE SYSTEMS	8
6.	PIPING.....	14
7.	DESIGN FLOWS.....	20
8.	SEPTIC TANKS AND GREASE INTERCEPTOR TANKS	23
9.	EFFLUENT DISTRIBUTION AND PUMP SYSTEMS	29
10.	PERCOLATION TESTS	34
11.	LEACHING SYSTEMS.....	35
12.	LEACHING SYSTEM SIZING.....	49
13.	MINIMUM LEACHING SYSTEM SPREAD (MLSS).....	50
14.	NITROGEN	56
15.	GROUNDWATER AND SURFACE WATER DRAINAGE	56
16.	WATER TREATMENT WASTEWATER	57
17.	NON-DISCHARGING TOILETS AND SEWAGE DISPOSAL SYSTEMS	59
APPENDICES		61
	APPENDIX A. APPROVED SEPTIC TANK EFFLUENT FILTERS	61
	APPENDIX B. APPROVED FILTER FABRIC FOR COVERING STONE AGGREGATE	62
	APPENDIX C. APPROVED NON-CONCRETE SEPTIC TANKS.....	63
	APPENDIX D. WATER TREATMENT WASTEWATER DISCHARGES TO SSDS	64

TABLE OF FIGURES

FIGURE 1. BUILDING SEWERS.....	14
FIGURE 2. PRESSURIZED WATER PIPE AND SSDS PIPE TRENCHES.....	15
FIGURE 3. TYPICAL SEPTIC TANK CONFIGURATION	24
FIGURE 4. TWO SEPTIC TANKS IN SERIES	25
FIGURE 5. STANDARD SEPTIC TANK CONFIGURATIONS.....	26
FIGURE 6. GREASE INTERCEPTOR TANK (GIT)	28
FIGURE 7. LEVEL LEACHING SYSTEMS	30
FIGURE 8. SERIAL DISTRIBUTION SYSTEMS	30
FIGURE 9. ALTERNATIVE DISTRIBUTION SYSTEMS AND D-BOX CONFIGURATIONS.....	30
FIGURE 10. PUMP CHAMBER	32
FIGURE 11. COMBINATION SEPTIC TANK/PUMP SYSTEM WITH TEE BAFFLE CONNECTION	33
FIGURE 12. MINIMUM SEPARATING DISTANCES ABOVE LEDGE ROCK AND MAXIMUM GROUNDWATER	35
FIGURE 13. LEACHING TRENCHES.....	40
FIGURE 14. LEACHING PITS	40
FIGURE 15. TYPICAL LEACHING GALLERY STRUCTURES.....	41
FIGURE 16. TYPICAL CURTAIN DRAIN CONSTRUCTION.....	57

TABLE OF TABLES

TABLE 1. SUBSURFACE SEWAGE DISPOSAL SYSTEM SEPARATION DISTANCE REQUIREMENTS.....	12
TABLE 2. APPROVED BUILDING SEWER PIPE FROM BUILDING SERVED TO SEPTIC TANK OR GREASE INTERCEPTOR TANK	16
TABLE 2-A. APPROVED EFFLUENT DISTRIBUTION PIPING.....	17
TABLE 2-B. APPROVED FORCE MAIN (PRESSURE) PIPING FOR SPECIFIC APPLICATIONS.....	18
TABLE 3. APPROVED TIGHT PIPE FOR GROUNDWATER OR SURFACE WATER PIPING WITHIN 25 FEET OF A SEWAGE SYSTEM	19

TABLE 4. NON-RESIDENTIAL AND RESIDENTIAL INSTITUTION DESIGN FLOWS	21
TABLE 5. SEPTIC TANK SIZING FOR RESIDENTIAL BUILDINGS	27
TABLE 6. REQUIRED EFFECTIVE LEACHING AREA CRITERIA FOR RESIDENTIAL BUILDINGS	49
TABLE 7. APPLICATION RATES FOR PROBLEMATIC SEWAGE FLOWS	49
TABLE 8. APPLICATION RATES FOR NON-PROBLEMATIC SEWAGE FLOWS	49
TABLE 9. WATER TREATMENT WASTEWATER DISPERSAL SYSTEM SEPARATION DISTANCE REQUIREMENTS	59

1. Scope, Usage Guide and Formatting Overview

Any manufactured product, technology, system, part, component, material or other item intended for use in a subsurface sewage disposal system, non-discharging system or water treatment wastewater dispersal system may be subject to review and approval pursuant to PHC section 19-13-B103d(c). The inclusion or listing of any such proprietary product, technology, system, part, component, material or other item in these Technical Standards or approval granted under PHC section 19-13-B103d(c) shall not constitute an endorsement of the product, technology, system, part, component, material or other item, nor shall it confer any intellectual property rights.

To improve usability, accessibility, and organization of these Technical Standards, a new numbering system for section and subsection headers has been implemented. This updated structure is intended to ensure clarity, consistency, and ease of navigation throughout the document.

The updated numbering system establishes a hierarchical sequential format in which headers are numbered to reflect its importance and relationship within the document. The schema follows this structure:

1. Primary Section Header (e.g., 1, 2, 3): Represents the primary sections of the document and provides a high-level overview of the content.
2. Secondary Subheader (e.g., 1.1, 1.2, 2.1): Breaks down the primary sections into more specific subtopics, offering additional detail.
3. Tertiary Subheader (e.g., 1.1.1, 1.2.1, 2.1.1): Provides greater detail on specific aspects of the subtopics.
4. Quaternary Subheader (e.g., 1.1.1.1, 1.2.1.1): Further subdivides tertiary subheaders to capture highly detailed points.

2. Acronyms and Abbreviations

AASHTO	American Association of State Highway and Transportation Officials
ABS	Acrylonitrile butadiene styrene
AGRU	Automatic grease recovery unit
ANSI	American National Standards Institute
ASTM	American Society for Testing and Materials
AWWA	American Water Works Association
BOD5	Biochemical Oxygen Demand, 5-day
C to C	Center to center
D-box	Distribution box
DOH	Local Director of Health
DOT	Connecticut Department of Transportation
ELA	Effective leaching area
FDM	Free draining material
FF	Flow factor
GIT	Grease interceptor tank
GPD	Gallons per day
GPM	Gallons per minute
HF	Hydraulic factor
Hg	Mercury
IAPMO	International Association of Plumbing and Mechanical Officials
Large SSDS	Large subsurface sewage disposal system (2,000 to 10,000 gallons per day)
lbs.	Pounds
LF	Linear feet
LPD	Low pressure distribution
MLSS	Minimum leaching system spread
NCR	Non-compliant repair
NSF	National Science Foundation
O and M	Operation and maintenance
OSHA	Occupational Safety and Health Administration
P.E.	Professional Engineer licensed in Connecticut
PE	Polyethylene
PF	Percolation factor
PHC	Public Health Code
PNR	Passive nitrogen reduction
PP	Polypropylene
PPD	Proprietary pressure-dosed dispersal system
psi	Pounds per square inch
PVC	Polyvinyl chloride
QC/QA	Quality Control/Quality Assurance
RS Depth	Receiving soil depth
SDR	Standard Dimension Ratio
SF	Square feet
SSDS	Subsurface sewage disposal system
SWIS	Storm water infiltration system
UL	Underwriters Laboratories
WTW	Water treatment wastewater

3. Subsurface Sewage Enforcement Officer

The local health director may authorize an individual to investigate, inspect and approve plans relating to subsurface sewage disposal systems if the individual holds a current certification as a Phase I or Phase II Subsurface Sewage Enforcement Officer, or if the individual is approved as an agent of local health in accordance with the requirements of section 21 of Public Act 26-142 until October 1, 2027. Such individual may conduct activities associated with enforcement of PHC sections 19-13-B103a through 19-13-B103g, inclusive, and these Technical Standards. No Subsurface Sewage Enforcement Officer shall conduct regulatory enforcement without being authorized by the local director of health. The local health director shall maintain records of such authorizations.

4. Definitions

Terms used in this document that are not defined in this section shall have the same meaning as used in the PHC sections 19-13-B100a(a) and 19-13-B103b. Certain definitions in this document include supplemental technical details; however, these additions are not intended to modify or conflict with the definitions in the PHC or Public Act 26-142. To the extent any conflict arises, the definitions in PHC and Public Act 26-142 shall control.

A. "Accessory structure" has the same meaning as PHC section 19-13-B100a(a). Accessory structures include, but are not limited to attached and detached garages, below-ground and above-ground pools, screened and enclosed 3-season (non-winterized) porches/sunrooms, open decks, tool and lawn equipment storage sheds, covered entryways, gazebos, barns, etc. Small (<200 square feet) portable structures (e.g., sheds) without permanent foundations (concrete slab, piers, footings) are not considered permanent structures, except for decks.

B. "Approved aggregate" means stone aggregate, or other product approved by the Commissioner for use in leaching system construction.

C. "Bedroom" means those areas within a residential building that are, or have the potential to be, utilized as a sleeping area on a consistent basis. To be deemed a bedroom the room shall meet all the following criteria:

- a. Be habitable space or planned habitable space that has "roughed-in" mechanicals (e.g., heating ducts, electrical wiring, water lines, plumbing waste lines) but is not currently "finished" for Building Code certificate of occupancy purposes. Small rooms with a floor area of less than 70 square feet (SF) are not considered bedrooms, unless the room has been historically designated a bedroom in an existing home. The Building Code stipulates that habitable rooms (except kitchens) shall have a floor area not less than 70 SF, therefore, bedrooms in new residential buildings are required to have a minimum floor area of 70 SF.
- b. Provides privacy to the occupants. Large (minimum 5-foot width) openings may be utilized to eliminate room privacy.
- c. Full bathroom facilities (containing either a bathtub or shower) are conveniently located to the bedroom served. Convenience in this case means on the same floor as the bedroom or directly accessed from a stairway.
- d. Entry is from a common area, not through a room already deemed a bedroom.

D. "Building served" means the physical structure that contains the habitable/interior portion of the building and the associated plumbing that discharges sewage to a sewage system. The building served includes any portion of the habitable structure permanently attached to the structure including, but not limited to, basements and 4-season (winterized) porches/sunrooms. The building served does not include attached accessory structures.

E. "Building sewer" or "house sewer" means the gravity pipe extending from the building served to the septic tank, grease interceptor tank, sewage holding tank, or exterior raw sewage pump vault. Pipes approved for use under this classification are listed in Table 2.

F. "Effluent" or "Sewage effluent" means the liquid portion of sewage produced after treatment in the septic tank.

G. "Foundation drain" or "footing drain" means a drainage system, consisting of stone or other free draining material, with or without piping, which is intended to collect and redirect groundwater to protect below grade portions of a building.

H. "Free draining material" means backfill that meets Connecticut Department of Transportation Form 817 Specification M.02.07 (or latest specification) and is coarser than the surrounding excavation material. (e.g., gravel, broken stone, rock fragments)

I. "Large subsurface sewage disposal system" means a subsurface sewage disposal system serving a building or buildings with a design sewage flow of 2,000 gallons per day or greater.

J. "Leaching gallery" means a hollow structure with an open bottom (minimum 40-inch width) with perforated walls surrounded by approved aggregate in a 6-foot-wide level excavation.

K. "Leaching pit" means a hollow, covered structure with perforated sides and surrounded by approved aggregate.

L. "Leaching system" means a structure, excavation, or product designed to allow sewage effluent to disperse into the receiving soil. Leaching systems include leaching trenches, leaching galleries, leaching pits, proprietary leaching systems, and dispersal components of proprietary pressure-dosed dispersal systems.

M. "Leaching trench" means a level excavation with vertical sides and flat bottoms filled with approved aggregate and equipped with an effluent distribution pipe running the entire length of the excavation.

N. "Multi-family" for the purposes of SSDS design, as outlined in sections 12 and 13, means 1 or more residential buildings that contain 2 or more distinct housing units, multiple single-family dwellings, or any combination thereof on the same property. "Multi-family" includes a single-family dwelling with an internal accessory apartment or a detached accessory apartment served by a central system.

O. "Outbuilding" means an ancillary structure served by a water supply and sewage system that is located on a property with an associated primary residential building, which cannot be split and sold separately from the primary building. Outbuildings include but are not limited to plumbed (water and sewage system plumbing) detached garages, workshops, barns, pool houses, game rooms, and accessory apartments.

P. "Proprietary leaching system" means a manufactured product approved by the Commissioner to be used as a leaching system, excluding the dispersal component of a proprietary pressure-dosed dispersal system.

Q. "Proprietary pressure-dosed dispersal system" means a manufactured dosing and dispersal system that uniformly applies effluent into the receiving soil via small diameter holes in small diameter distribution piping and has been approved by the Commissioner to be used as a leaching system.

R. "Receiving soil" means the soil in the leaching system area and surrounding soil that is available to disperse effluent. Receiving soil characteristics (e.g., depth, percolation rate) determines the configuration and sizing of a leaching system.

S. "Secondary safety lid" or "Secondary safety device" means a sewage tank access safety device installed in a riser below the riser cover that is commercially manufactured for the purpose of preventing accidental entry into sewage tanks. Sewage tank access safety devices can be either a secondary cover on the tank access opening, or a product manufactured and sold as a safety device that is installed below the riser cover. The manufactured device shall be capable of withstanding a minimum 200 lbs. deadload.

T. "Select fill" means clean bank run sand, clean bank run sand and gravel, or approved manufactured fill meeting the gradation and specifications stipulated in section 9.1.12 or the ASTM C 33 standard for fine aggregate.

U. "Sewage Tank" means a septic tank, grease interceptor tank, pump chamber or sewage holding tank.

V. "Solid pipe" means pipe that has no loose or open joints, perforations, slots, or porous openings that would allow liquid to leak into or out of the pipe.

W. "Stone aggregate" means crushed or broken stone or crushed and uncrushed gravel meeting the gradation requirements for No. 4 or No. 6 coarse aggregate (See section 9.1.11) in Table M.01.02-2 and the coarse aggregate criteria by pit/quarry source in Table M.01.02.1 per Connecticut Department of Transportation Form 817 (or latest revision). The above noted criteria concern Loss of Abrasion, Soundness by Magnesium Sulfate, and fines (material passing No. 200 sieve: 1% maximum).

X. "Tight pipe" means a solid pipe that exhibits both acceptable wall strength and watertight joints. Pipes approved for use under this designation are listed in Table 3.

Y. "Watertight tank seal" means a pipe to tank connection (inlet and outlet pipe seal) that meets ASTM C 1644, ASTM C 923, or is accepted by the Commissioner as an approval equal based on review of a company's submission of specifications and supporting documentation.

5. Location of Sewage Systems

5.1 Separating Distances (Table 1)

The minimum separating distances for a subsurface sewage disposal system (SSDS) installation or repair, except for approved SSDS piping, from various items are specified in Table 1. Separating distances are based on horizontal measurements except for non-vertical closed loop geothermal system bore holes that may be drilled at an angle and are measured from the closest point of the bore hole. An SSDS that requires an exception to the minimum separating distance to any item in Table 1, except Item A, requires an exception from the DOH in accordance with PHC section 19-13-B103d(a)(1). The minimum separating distances shall be maintained for existing sewage systems, (SSDSs, cesspools, sewage holding tanks, and privies), except for the replacement of a component of a previously permitted SSDS at a distance no closer to the sewage system.

5.1.1 Cesspools

Cesspools are antiquated sewage systems that do not have a septic tank. Cesspools have the same separating distances as leaching systems for Table 1 purposes. Cesspool abandonment is recommended and typically occurs at the time of a real estate transaction. The Federal Underground Injection Control program required large capacity cesspools that serve multi-family residential building(s) or non-residential buildings serving 20 or more people per day to be abandoned by April 5, 2005.

5.2 Approved Piping

Tables 2, 2-A and 2-B list approved SSDS piping for building sewers, effluent distribution pipes and force mains, and the tables specify minimum separation distances for approved SSDS piping to a water supply well and other items. SSDS piping may also be approved by the Commissioner after the current revision of the Technical Standards, pursuant to PHC section 19-13-B103d(c). Installation or repair of approved SSDS piping that does not

comply with the minimum separating distances in Tables 2, 2-A, and 2-B, requires an exception from the DOH in accordance with PHC section 19-13-B103d(a)(1).

5.3 Storm Water Infiltration System

Item H in Table 1 specifies the minimum separating distance between a storm water infiltration system (SWIS) and a sewage system, however there are certain instances where increased separation may be warranted. A SWIS that receives large quantities of water collected from an impervious cover area on a site that has hydraulic limitations may represent a concern for the proper operation of a nearby SSDS. A SWIS shall not create localized groundwater mounding in the vicinity of a SSDS to maintain unsaturated soil conditions beneath the leaching system for wastewater renovation purposes. A SWIS may impact hydraulic conditions, and installation of a SWIS may be subject to a DOH review pursuant to PHC section 19-13-B100a(e). The DOH may require an evaluation of a proposed SWIS on groundwater mounding to ensure the SWIS will not affect the operation of a nearby SSDS. Such an evaluation must demonstrate the receiving soil in the leaching system area is not hydraulically overloaded and that unsaturated soil conditions beneath the leaching system shall be maintained for a 1-inch rain event. Municipal low impact development and storm water management programs shall be coordinated with the DOH for new lot creation, new construction, and SWIS retrofits on developed sites in areas utilizing SSDSs.

5.4 Commissioner Exceptions: Small Community Subsurface Sewage Disposal Systems, Off-Site Subsurface Sewage Disposal Systems, and Water Supply Well Distances

An exception to the location requirements may be granted by the Commissioner in accordance with the provisions in PHC section 19-13-B103d(a)(2) for SSDS construction, installation, repair, replacement, alteration or extension upon application. The Commissioner may approve an exception upon review and determination that the application for an exception complies with the requirements in subsections 5.4.1, 5.4.2 or 5.4.3. Sewage holding tank exceptions are submitted pursuant to requirements in section 17.8 of the Technical Standards and section 19-13-B103f(f) of the PHC. Applications for exceptions are available on the Department's website. Building conversion or a "Change in Use" as defined in PHC section 19-13-B100a(a) require that a code-complying area be identified for each building on the property generating sewage. Compliance with this regulation needs to be demonstrated prior to the DOH applying for an exception to the Commissioner for approval.

5.4.1 Small Community Sewage Systems

A small community sewage system exception may be granted upon finding by the Commissioner that the small community sewage system meets the requirements in PHC section 19-13-B103d(a)(2)(A) and the criteria set forth in this section.

For any small community sewage system for which an exception is granted pursuant to PHC section 19-13-B103d(a)(2), the party responsible for repair and maintenance of the system shall be the owner of the lot unless otherwise identified by the applicant upon application for the exception.

Requests for small community sewage systems shall not be approved to connect a new building into an existing SSDS that is not compliant with PHC sections 19-13-B103a through 19-13-B103g, inclusive, and 19-13-B100a.

5.4.2 Off-Site Subsurface Sewage Disposal System

An off-site subsurface sewage disposal system is an SSDS, or any component, that is not located on the same lot as the building served and located on an easement. An exception may be granted for an off-site SSDS in accordance with PHC section 19-13-B103d(a)(2)(B).

For an off-site SSDS, an SSDS design plan delineating the easement area and associated easement referencing the plan and limits of the easement area shall be submitted with the application. The boundaries of the easement area are equivalent to property line setback distances in Table 1. Compliance with PHC section 19-13-B100a must be demonstrated prior to easement approval if the property where the easement is to be located contains a sewage system.

5.4.3 Water Supply Well Distances

The minimum separating distance for the repair or replacement of an existing subsurface sewage disposal system from a water supply well shall comply with the requirements specified in Table 1, Item A. The installation of a repair or replacement SSDS that requires an exception to the minimum separating distance in Table 1, Item A can only be granted by the Commissioner in accordance with PHC section 19-13-B103d (a)(2)(C). A new SSDS shall meet the minimum separating distances specified in Table 1, Item A.

In cases where only the sewage tank or leaching system is being replaced, an evaluation of the existing SSDS by the DOH may be required. The SSDS components to be evaluated may include, an evaluation of the condition of the existing sewage tanks (condition, size, number of compartments, presence and condition of baffles and outlet filter) or evaluation of the distribution box and piping (liquid level, presence/absence of sludge accumulation) or a leaching system summary (length, product, functionality, capacity). Single compartment septic tanks shall only be allowed to remain in use if the single compartment tank is evaluated and determined to be in satisfactory condition and properly baffled. Some proprietary leaching system companies do not support the use of their products with single compartment septic tanks.

5.5 Benchmarks and Plan Adherence

SSDS plans shall provide benchmarks with both vertical and horizontal controls unless field staking is required and confirmed by the DOH. SSDS plans shall include information about the placement of the SSDS relative to restrictive layers and fixed reference points. Licensed installers are responsible for constructing the SSDS in accordance with the plans approved by the DOH in accordance with PHC section 19-13-B103e(e). Modifications to an approved plan shall be authorized by the plan designer and approved by the DOH.

5.6 As-Built Plan

Following SSDS installation and final inspection, an as-built plan of the SSDS shall be submitted to the DOH in accordance with PHC section 19-13-B103e(f)(4). The as-built plan shall identify the building sewer exit location from the building, sewage system access points, including but not limited to tank cleanouts and distribution boxes, and leaching system ends. The as-built can be a plan to scale or a tie-plan from 2 or more permanent reference points. Tie-plans shall specify the distance between reference points. A licensed installer shall prepare and submit the as-built plan, unless an engineered as-built plan is required by the DOH in accordance with PHC section 19-13-B103d(g) and 19-13-B103e(f)(4) or the DOH accepts an as-built plan prepared by a licensed land surveyor. As-built plans shall be submitted in a timely manner to avoid delays in permit issuance by the DOH in accordance with PHC section 19-13-B103e(j).

5.7 Unused System Abandonment

Pursuant to PHC section 19-13-B103e(g)(4), the DOH may order the abandonment of an unused subsurface sewage disposal system or of any hollow component thereof, or cesspool when failure to properly abandon such system or component poses a public health or safety risk. Abandonment of any hollow SSDS component (e.g., septic tank, pump chamber, leaching chamber) or cesspool shall be performed in a manner to eliminate the danger of an inadvertent collapse. The property owner shall make arrangement for abandonment of any hollow SSDS component or cesspool. Hollow structures shall be emptied of all septage prior to abandonment. Structures shall be filled with sand, gravel, or other DOH approved material (e.g., concrete), crushed in place, or removed from the site for disposal as approved by the DOH. The DOH may authorize a former sewage system component (except steel tanks or cesspools) in compliance with Table 1 to be utilized for another purpose (e.g., water treatment wastewater dispersal system) rather than be formally abandoned if the property owner demonstrates the component is in acceptable condition and such use will not cause a health hazard or nuisance condition. Repurposed structures left in place shall be located on a plot plan and noted in the property file.

5.8 Central Subsurface Sewage Disposal System

Pursuant to PHC section 19-13-B103d(f), each building shall be served by a separate subsurface sewage disposal system, unless an exception is granted by the Commissioner for a small community sewage system (section 5.4.1.) or a central subsurface sewage disposal system is approved by the DOH.

a “Change in Use” as defined in PHC section 19-13-B100a(b), require that a code-complying area be identified on the property for each building discharging sewage. A central SSDS request proposing to connect a new or existing building to an existing SSDS shall be submitted to the DOH with a plan or sketch demonstrating compliance with PHC section 19-13-B100a. Information on an existing SSDS is required when determining whether the proposed central subsurface sewage disposal system is sufficient to serve the buildings. If this information is not available, an evaluation of the existing SSDS may be required by the DOH. The DOH may specify the components or area for evaluation based on the application, which may include an evaluation of the condition of the existing sewage tanks (condition, size, number of compartments, presence and condition of baffles and outlet filter), or an evaluation of the distribution box and piping (liquid level, presence or absence of sludge accumulation), or a leaching system summary (length, product, functionality, capacity). Upon determination that an existing system is sufficient to serve the buildings, the DOH may approve the central SSDS application.

Central SSDS shall not be granted that allow a new or existing building to be connected to an existing cesspool, steel septic tank, or failed or malfunctioning SSDS. The replacement of a single compartment septic tank shall be required by the DOH whenever there is an increase in the design flow to the existing tank or the outbuilding includes the discharge of a raw sewage pump into the existing tank.

Table 1. Subsurface Sewage Disposal System Separation Distance Requirements

Item	Separating Distance (Feet)	Special Provisions
A. Water Supply Well Applies to potable, open-loop geothermal, irrigation, and/or spring wells with a required withdrawal rate in gallons per minute (GPM): < 10 GPM 10 to 50 GPM > 50 GPM	75 150 200	Distance from a water supply well to a leaching system shall be doubled if the receiving soil percolation rate is faster than 1.0 minute per inch and the bottom of the leaching system is less than 8 feet above ledge rock.
B. Building Served	10	See Item G for buildings with ground control drains.
C. Open Watercourse	50	For lots in existence prior to 8/16/1982 that are not on a public water supply watershed, the distance shall be reduced to not less than 25 feet. In coastal areas, the Coastal Boundary shall be considered the open watercourse limit, unless site-specific information on high-tide elevations on a property establishes the open watercourse limit.
D. Public Water Supply Reservoir	100	
E. Solid Piping for the Conveyance of Surface or Groundwater Discharge	25	Distance to tight pipe (See Table 3) shall be reduced to 5 feet if the pipe excavation is not backfilled with free draining material (FDM).
F. Storm Water Structure <i>Catch basins, manholes</i>	25	Distance to sewage tank shall be reduced to 10 feet if storm water structure is watertight and constructed with rubber joint seals and watertight pipe connection seals (e.g., ASTM C 923). Storm water structures shall not be designed to collect groundwater (See Item G).
G. Groundwater Drain <i>Curtain, Foundation, Sumps</i> Up-Gradient or On Sides Down-Gradient	25 50 ¹	No drain shall be constructed near a sewage system for the purpose of collecting partly treated sewage, regardless of distance. ¹ Distance to the sewage tank shall be reduced to 25 feet if the tank is verified to be watertight.
H. Storm Water Infiltration System (SWIS) Single-Family Residential Lots Other Lots (e.g., Commercial, Multi-Family Residential)	50 ² 75 ^{3,4}	Distance shall be reduced to 25 feet to sewage tank. ² Distance shall be reduced to 25 feet to a leaching system if MLSS is not applicable or the SWIS is not up-gradient or down-gradient. Distances may be further reduced to 10 feet for minor SWIS (e.g., rain gardens) with the approval from the DOH if demonstrated that the leaching system or sewage tank shall not be adversely impacted. ³ Distance shall be reduced to 50 feet to a leaching system if MLSS is not applicable or the SWIS is not up-gradient or down-gradient, or with the approval from the DOH if demonstrated that the leaching system shall not be adversely impacted. Distances may be further reduced to 25 feet for minor SWIS (e.g., rain gardens) with the approval from the DOH if demonstrated that the leaching system shall not be adversely impacted. ⁴ The DOH may require increased distances or an engineered assessment on the operation of the leaching system if localized groundwater mounding is a concern.
I. Top of Embankment Refers to fill package around perimeter of the leaching system.	10	See Figure 12 Note: Distance does not apply to the sewage tank.

Item	Separating Distance (Feet)	Special Provisions
J. Property Line Upgradient and On-Sides Down-Gradient	15 ⁵ 25 ⁶	Distance to the sewage tank and the reserve leaching area shall be reduced to 10 feet. ⁵ Distance shall be reduced to 10 feet if the top of the leaching system is below original grade, grading rights from the affected property owner are secured, or retaining walls are utilized (See section 9.1.8 for retaining wall provisions). ⁶ Separating distances between leaching system and down-gradient property line shall be reduced to 15 feet if MLSS is not applicable or on flat groundwater table lots; further reduction may be allowed as cited in footnote 5 if either condition exists.
K. Water Piping Pressure (e.g., potable, irrigation) Water Supply Suction	10 ⁷ 75 ⁸	⁷ Water line trench excavations less than 25 feet from the leaching system shall <u>not</u> be backfilled with FDM. ⁸ Distance between water suction pipe and sewage tank shall be reduced to 25 feet if the tank is verified to be watertight.
L. Below-Ground Swimming Pool	25	See Item G for down-gradient pools with groundwater control drains.
M. Above-Ground Swimming Pool	10	Includes hot tubs, except on decks.
N. Accessory Structure(s) except for above and below ground pools	10	Distance to structure without full-wall, frost-protected footings shall be reduced to 5 feet. See Item G if drains are provided.
O. Utility Service Trench (e.g., electric, gas)	5	Utility trench excavations less than 25 feet from the leaching system shall not be backfilled with FDM. It is recommended that detectable underground magnetic tracer and/or warning tape be provided at least 1 foot above buried utility lines within 25 feet of a SSDS. Note: distance does not apply to electrical and alarm connections to sewage tanks.
P. Buried Fuel Tanks	25	Distance to sewage tank shall be reduced to 10 feet. Distance to leaching system shall be reduced to 10 feet if not down-gradient of leaching system. See Item G if drains provided.
Q. Water Treatment Wastewater (WTW) Dispersal System Small Discharge (<150 GPD) Medium Discharge (150-500 GPD) Large Discharge (> 500 GPD)	25 ⁹ 50 ¹⁰ 75 ¹¹	Distance to sewage tank shall be reduced to 10 feet. Distance to WTW dispersal system non-discharging settling or filtration structures and solid piping shall be reduced to 10 feet; however, solid piping excavations shall not be backfilled with FDM. ⁹ Distance to leaching system shall be reduced to 10 feet if MLSS is not applicable or if the WTW dispersal system does not discharge up-gradient or down-gradient of the leaching system. ¹⁰ Distance to leaching system shall be reduced to 25 feet if MLSS is not applicable or if the WTW dispersal system does not discharge up-gradient or down-gradient of the leaching system. ¹¹ The DOH may require an increased distance or an engineered assessment on the impacts of localized groundwater mounding in the vicinity of a SSDS.
R. Closed Loop Geothermal System Bore Hole, Trench Geothermal Piping to Borehole/Trench	25 5	Geothermal piping excavations less than 25 feet from leaching system shall not be backfilled with FDM.
S. Grade Cuts or Soil Disturbances Down-Gradient of Leaching System	50	A soil cut within 50 feet down-gradient of a leaching system shall not be allowed if bleed-out from cut is a concern. Distance may be reduced with the approval of the DOH if it is demonstrated the cut/soil disturbance preserves the leaching system's receiving soil (See MLSS section 11).

6. Piping

6.1 Building Sewers

Building sewers shall be a minimum 4 inches in diameter and shall be approved piping per Table 2. A minimum grade of $\frac{1}{4}$ inch per foot (approximately 2.1%) shall be provided for 4 inch diameter building sewers, and $\frac{1}{8}$ inch per foot for 6 and 8 inch diameter building sewers. The minimum grade requirement shall be provided for the entire building sewer. Building sewers shall have tight joints to the septic tank or grease interceptor tank and be in a straight line with uniform grade wherever possible. Accessible manholes or surface cleanouts shall be provided at one or more cumulative changes of directions exceeding 45° (Figure 1), unless a 90° sweep pipe approved in Table 2 is utilized. When a cleanout is provided for a multi-bend change in direction, the cleanout shall be provided prior to the first change in direction.

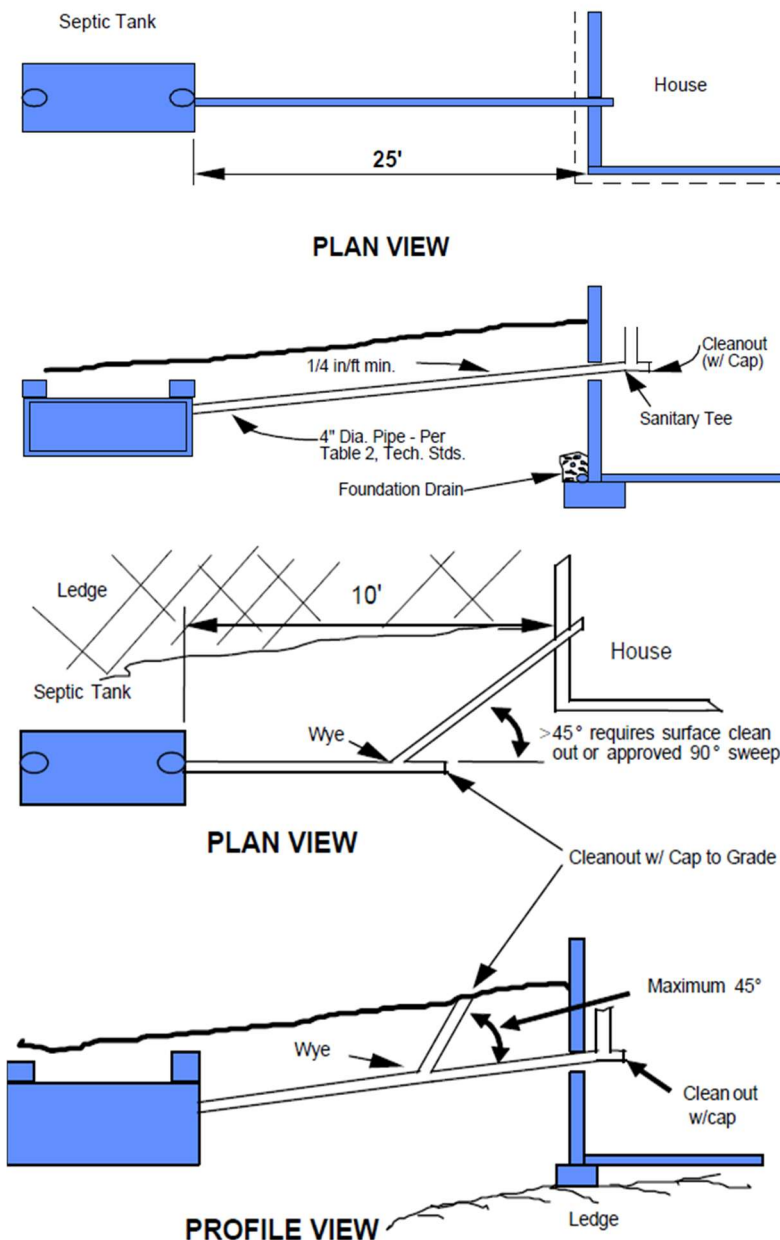


Figure 1. Building Sewers

For SSDS repairs that include a new building sewer, an exterior cleanout shall be provided if the building's foundation is a slab on grade and there is no interior cleanout provided within the building. Accessible manholes or surface cleanouts shall be provided for each 75 foot length of building sewer from the foundation wall to the septic tank or grease interceptor tank. Long building sewer lines shall be avoided to reduce the danger of groundwater infiltration and sewer blockages. Approved building sewer piping located within the sanitary radius of a water supply well shall provide the minimum separation distances specified in Table 2. Building sewer foundation penetrations shall comply with the plumbing code, which is under the purview of the local building official.

6.2 Effluent Distribution Piping

No cast iron or ductile iron piping shall be allowed following the septic tank or grease interceptor tank due to the corrosive nature of the effluent. Table 2-A lists approved effluent distribution piping. All solid effluent distribution piping located within 25 feet of a drain or open watercourse, or within the sanitary radius of a water supply well shall be higher grade piping (e.g., ASTM 3034, SDR 35) with tight joints (rubber gaskets or glued connections) per Table 2-A, and shall provide the minimum separation distances specified in Table 2-A. Solid effluent distribution piping between a septic tank and a leaching system shall not have negative pitch. Perforated distribution piping shall only be used within the footprint of the leaching system.

6.3 Force Main Piping

Force main piping subject to pressure from a pump or other dosing system shall have a pressure rating higher than the anticipated operating pressure for the application. Metal pipe (e.g., cast or ductile iron) shall not be used as a force main. Approved force main pipes are listed in Table 2-B. Approved force main piping located within the sanitary radius of a water supply well shall provide the minimum separation distances specified in Table 2-B.

6.4 Floor Drains

Floor drains located in kitchen and bathroom areas may be connected to the SSDS if not receiving hazardous substances. All other floor drains, including drains receiving hazardous substances, are not permitted to discharge into the SSDS and, if required, shall comply with the appropriate General Permit from the Department of Energy and Environmental Protection.

6.5 Groundwater and Surface Water Drainage Piping

Table 1 (Item E) specifies the minimum separating distances for groundwater and surface water drainage piping. As noted in the special provisions, approved tight piping allowed within 25 feet of a sewage system are listed in Table 3. Leakage testing may be required to verify water tightness. ASTM standards specify leakage test procedures for various types of piping. A low-pressure air test for plastic (PVC, PP, and PE) non-pressure piping is specified in ASTM F 1417, and concrete pipe testing is covered by ASTM C 924.

6.6 Water Supply Piping

Table 1 (Item K) specifies the minimum separating distances for water piping. SSDS pipes shall be located a minimum of 25 feet from water supply suction pipes, and shall be approved piping (Tables 2, 2-A, and 2-B). Pressurized water lines and SSDS piping shall be in separate trenches at least 10 feet apart whenever possible. When installed in the same trench, the water pipe shall be laid on a trench bench at least 18 inches above the top of the SSDS pipe and at least 12 inches (preferably 18 inches) from the side of the SSDS pipe trench (See Figure 2). When necessary to cross a pressurized water line with a solid effluent distribution pipe, the distribution pipe shall be approved piping (Table 2 or Table 2-A). Table 2 shall apply when the water line is located below the distribution pipe. Table 2-A shall apply when the water line is located above the distribution pipe. Building sewer pipes listed in Table 2, and force main pipes listed in Table 2-B may cross over or under pressurized water lines. Placement of pipe joints on pressurized water supply pipe and SSDS pipe at crossing points shall be avoided.

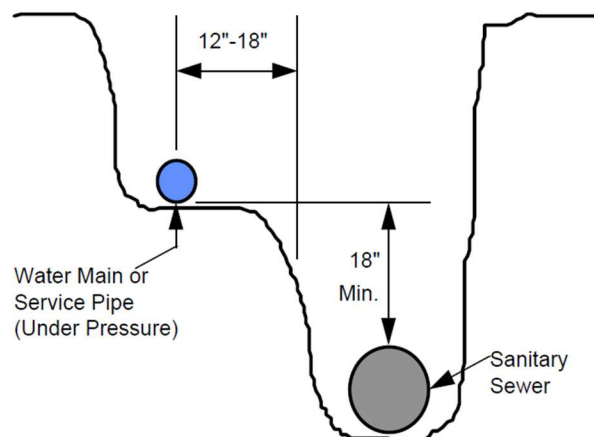


Figure 2. Pressurized Water Pipe and SSDS Pipe Trenches

Table 2. Approved Building Sewer Pipe from Building Served to Septic Tank or Grease Interceptor Tank

Table 2 lists piping approved for building sewers from the foundation wall of the building served to a septic tank or a grease interceptor tank. Building sewer piping requirements are outlined below:

1. Building sewer within the sanitary radius of a water supply well, but no closer than the following minimum distances based on withdrawal rates:
 - <10 gpm: 25 feet
 - 10 – 50 gpm: 75 feet
 - >50 gpm: 100 feet
2. Building sewers shall maintain a minimum of 25 feet from a water suction pipe.
3. Building sewers and pressurized water lines shall be installed in accordance with section 5.
4. Building sewers shall be kept a minimum of 10 feet from closed loop geothermal bore holes and trenches. There are no minimum distances between building sewers and other items listed in Table 1. However, items placed near building sewers shall not damage or compromise the integrity of the pipe.
5. The DOH shall inspect all building sewer piping and joints prior to covering.

Pipe Description	Acceptable Joint	Conditions for Use
Cast iron hubless ASTM A888	Cast iron split sleeve bolted joint with rubber gasket, MG Coupling or equal OR 3"-wide, heavy-duty, stainless steel banded coupling with rubber gasket; Clamp-All, ANACO SD 4000 Coupling, or equal	Roll-on "donut type" gaskets not acceptable if connection is within 25 feet of foundation wall. Pipe shall be properly bedded, laid in straight line on uniform grade Couplings without shear bands can be used for joint connections between cast iron pipe and the bell end of an approved PVC Schedule 40 or 80 pipe
Cast iron bell and spigot ASTM A74	Rubber compression gaskets	Stainless steel 3" wide shear band coupling required for connection of dissimilar piping materials
PVC Schedule 40 or 80 ASTM D1785 or ASTM D2665	Rubber compression gasket couplings, Harco Mfg., ASTM D 3139 or equal* OR Solvent weld couplings/ fittings using proper two-step PVC solvent solution procedure Gripper Gasket LLC Maxadaptor Sewer Repair Coupling	*Use of 3"-wide approved stainless steel banded couplings on PVC, ASTM D 1785 or 2665 is acceptable for 4" diameter pipe. Use of 4" wide approved stainless-steel couplings are required for 6" and 8" pipe. UL (gray) Piping - Schedule 40 or 80- 36" min. radius sweep piping (90°) may be utilized without a cleanout. ABS Schedule 40 is not acceptable
Ductile iron ANSI A21.51	Rubber compression gaskets	Connection to cast iron building sewer shall be made with compression gaskets.
PVC AWWA C900 (PC 150 psi min.)	Rubber compression gaskets	"O"-ring gasket is not acceptable
PVC ASTM F 1760, Schedule 40	Rubber compression gaskets	Only 4" pipe approved Minimum 12" cover in vehicular loaded traffic areas

Table 2-A. Approved Effluent Distribution Piping

Solid and perforated effluent distribution piping listed in Table 2-A is approved for use after the septic tank. Solid non-metal piping listed in Table 2 may also be utilized as effluent distribution piping, and shall be allowed at the below distances to wells, drains, etc. Requirements are outlined below:

1. *Solid distribution pipe within the sanitary radius of a water supply well, but no closer than the following minimum distances based on withdrawal rates:
 - <10 gpm: 25 feet
 - 10 – 50 gpm: 75 feet
 - >50 gpm: 100 feet
2. *Solid distribution pipe shall maintain a minimum of 25 feet from a water suction pipe.
3. *Solid distribution piping within 25 feet of an open watercourse, or surface or groundwater drain (curtain/foundation).
4. *Solid distribution pipe and pressurized water lines shall be installed in accordance with section 5.
5. *Solid distribution pipe shall be kept a minimum of 10 feet from closed loop geothermal bore holes and trenches.
6. There are no minimum distances between solid distribution pipe and other items listed in Table 1. However, items placed near distribution piping shall not damage or compromise the integrity of the pipe.
7. Solid effluent distribution piping and water piping shall be installed in accordance with section 5.
8. The DOH shall inspect all effluent distribution piping and joints prior to covering.

Pipe Description	Type Of Joint	Conditions for Use
*PVC ASTM D 3034, SDR 35 *PVC ASTM F 789, PS-46 *PVC ASTM F 891, PS-50 or PS-100 *PVC ASTM F1760, SDR35	*Rubber compression gasket, or solvent weld couplings/fittings w/ two-step PVC solvent solution procedure. Bell and spigot with no gasket	Heavy duty plastic pipe for shallow pipe installation
PVC ASTM D 2729 - only 3" diameter pipe (see remarks for use of 4" pipe)	Bell and spigot, no gaskets	4" diameter pipes can be used but shall be bedded in 6" min. of approved aggregate and covered with 2" min. of aggregate or with other special bedding requirements to protect against crushing
PE ASTM F 810 (Perf. Spec.), SDR 38/ ASTM D 3350 - only 3" diameter pipe (see remarks for use of 4" pipe)	Bell and spigot, no gaskets	4" diameter corrugated smooth interior wall polyethylene leaching
PE corrugated rigid pipe: ASTM 1248 (coil pipe not acceptable) - only 3" diameter pipe (see remarks for use of 4" pipe)	Sleeve joints	pipe meeting ASTM D 3350 and performance specification ASTM F 405 may be used without bedding
*PE ADS N-12, ASTM F 667, AASHTO M-294	*Series 35 ADS coupling, o-ring gasket or WT Pipe/joint (Gasketed bell/spigot) Snap on sleeve joint	*Coupling: ASTM D 3034/F 1336. Joints (Coupling and WT) meet ASTM D 3212

Table 2-B. Approved Force Main (Pressure) Piping for Specific Applications

1. Force main piping within the sanitary radius of a water supply well, but no closer than the following minimum distances based on withdrawal rates:
 - <10 gpm: 25 feet
 - 10 – 50 gpm: 75 feet
 - >50 gpm: 100 feet
2. Force main piping shall maintain a minimum of 25 feet from a water suction pipe.
3. Force main piping within 25 feet of an open watercourse, surface or groundwater drains (curtain/foundation).
4. Force mains and pressurized water lines shall be installed in accordance with section 5.
5. Force mains shall be kept a minimum of 10 feet from closed loop geothermal bore holes and trenches.
6. There are no minimum distances between force mains and other items listed in Table 1. However, items placed near force mains shall not damage or compromise the integrity of the pipe.
7. Force main piping and water piping shall be installed in accordance with section 5.
8. The DOH shall inspect all force main piping and joints prior to covering.

Pipe Description	Acceptable Joint	Conditions for Use
PVC pressure pipe ASTM D 2241: SDR 21, 17, or 13.5	Bell and spigot with compression rubber gaskets	
PVC pressure water pipe AWWA C900 (PC 150 psi minimum)		
PVC ASTM D 1785 / ASTM D 2665, Schedule 40 or Schedule 80	Solvent welded, threaded joints or gasketed couplings	
PE ASTM D 2239 PE ASTM D 2737 PE ASTM D 3035, SDR 11 or lower	No joints within 75 ft. of well or 25 ft. of open watercourse, ground or surface water drains No joints, Heat butt-fused connections	Pipe available in 100 ft. and longer coiled lengths

Table 3. Approved Tight Pipe for Groundwater or Surface Water Piping within 25 Feet of a Sewage System

Solid groundwater and surface water drainage pipes within 25 feet of a sewage system.

Pipe Description	Acceptable Joint	Conditions for Use
Cast iron hubless pipe ASTM A-888	Cast iron split sleeve bolted connector with rubber gasket MG Coupling or 3"-wide, heavy duty stainless steel banded coupling with rubber gasket; Clamp-All, ANACO SD 4000 Coupling or equal	Roll-on "donut type" gaskets not acceptable if used within 25 ft. of watercourse or drain. Pipe shall be properly bedded in accordance with manufacturer's specifications, laid in a straight line on a uniform grade
Cast iron bell and spigot ASTM A-74	Rubber compression gaskets	
Ductile iron ANSI A21.51	Rubber compression gaskets	
Extra strength PVC pressure water pipe AWWA C900 (PC 100 psi min.)	Rubber compression gaskets	
Reinforced Concrete Pipe ASTM C 76	Rubber compression gaskets, ASTM C 443	*Use of 3"-wide approved stainless steel banded couplings on PVC ASTM D 1785 is acceptable ABS Schedule 40 is not acceptable
Reinforced concrete water pipe, steel cylinder type, AWWA C300/ C-301	Rubber compression gaskets	
Schedule 40 or 80, PVC ASTM D 1785 or ASTM D 2665 PVC ASTM D 2241: SDR 21, 17 or 13.5	Rubber compression gasketed couplings, Harco Mfg., ASTM D3139 or equal* or Solvent weld couplings/fittings using proper two-step PVC solvent solution procedure	
PVC ASTM F1760, SDR 35 PVC ASTM D 3034, SDR 35 PVC ASTM F 789 PVC ASTM F 679	Rubber compression gaskets or Solvent weld couplings/fittings using proper two-step PVC solvent solution procedure	
PVC, CONTECH A-2026, ASTM F 949	Elastomeric gasket meets ASTM F 477	Joint meets ASTM D 3212
PVC, CONTECH A-2000, ASTM F 949	Gaskets meet ASTM F 477	Joint meets ASTM D 3212
PE, ADS N-12, ASTM F 2648 AASHTO M-294, 24 inch maximum diameter PE ASTM D 2239 and D 2737 pressure pipes	Series 35 ADS coupling, o-ring gasket or WT Pipe/joint (Gasketed bell/spigot)	Coupling: ASTM D 3034/F 1336 Joints (Coupling and WT) meet ASTM D 3212
N-12 Mega Green WT IB pipe (ASTM F 2648) (4" to 24" diameters)	Gasketed bell and spigot joint	Joint meets ASTM D 3212
PP, ADS HP Storm Pipe, ASTM F2881, AASHTO M330, 12" – 30" diameters	Gasketed bell and spigot joint	Joint meets ASTM D 3212
PP, ADS SaniTite HP Sanitary Pipe, AASHTO M330, ASTM F2764 (12" – 60" diameters)	Gasketed bell and spigot joint	Joint meets ASTM D 3212

7. Design Flows

7.1 Residential Buildings

Design flows for residential buildings shall be based on the number of bedrooms on the property and the following:

- 150 GPD per bedroom for a maximum of 3 bedrooms.
- 75 GPD per bedroom for each bedroom beyond the first 3 bedrooms, for a single-family residential building.
- 125 GPD per bedroom for each bedroom beyond the first 3 bedrooms for multi-family residential building(s), including bedrooms in separate multi-family residential buildings on the same property, residential outbuildings, and internal/attached accessory apartments.

7.2 Non-residential Buildings and Residential Institutions

Table 4 shall be used to determine design flows for non-residential buildings and residential institutions unless specific water use data (minimum 1 year period) is available from the building or similar facilities.

Whenever water use data is utilized to calculate the design flow, data shall be accompanied with additional information (e.g., building size, plumbing fixture information, hours of operation) in support of the design. Design flows based on metered flows shall use a minimum 1.5 safety factor applied to the average daily water use.

Design flows not listed in Table 4 or obtained from water use data shall be based on the best fit in Table 4 as determined by the DOH or Commissioner.

The strength of the wastewater can be correlated to the 5-day biochemical oxygen demand (BOD₅). For reference purposes, a wastewater BOD₅ concentration of 110 mg/l is weak, 220 mg/l is medium, and 400 mg/l is strong. Weak strength wastewater or non-problematic wastewater application rates are found in Table 8. Strong strength wastewater or problematic wastewater application rates are found in Table 7. Table 7 application rates shall be utilized for medium strength wastewater for a conservative design unless otherwise approved by the Commissioner.

7.2.1 Problematic Sewage

Problematic sewage is wastewater that is a concern due to the nature or strength (medium and high BOD₅ concentration) of the sewage. The required effective leaching area (ELA) for SSDSs serving restaurants, bakeries, food establishments, residential institutions, laundromats, beauty salons, and other non-residential buildings with problematic sewage is based on the design flow and the application rates in Table 7. Table 4 designates these establishments and buildings and associated discharges with a notation indicating that Table 7 application rates shall apply.

7.2.2 Non-problematic Sewage

Non-Problematic sewage has a weak BOD₅ concentration. The required ELA for SSDSs serving non-residential buildings with non-problematic sewage is based on the design flow and the application rates in Table 8.

Table 4. Non-Residential and Residential Institution Design Flows

Building Type	Design Flow (GPD)
Schools (Per Pupil)	
Base Flows (Excludes Kitchens and Showers)	
High School	12
Junior High/Middle School	9
Kindergarten/Elementary School	8
Day Care Center	10
Additional Flows for Kitchens and Showers (to be added to base flow)	
Kitchen (Table 7 Application Rate)	3
Showers	3
Residential (Boarding)	100
Commercial Buildings ⁽¹⁾	
Office (Average 200 SF gross area/person), per employee	20
Retail/Supermarket Building ⁽²⁾ , per SF gross area	0.1
Industrial Building, per SF of gross area	0.1
Factory (Average 200 SF gross area/person), per employee ⁽³⁾	25
(1) Design flows for commercial buildings may be reduced if documentation (e.g., building/floor plans, statement of use) supports the reduction. (2) Supermarkets shall increase design flow to account for delis and bakeries. Deli and bakery flows use the Table 7 application rate. (3) Add 10 GPD to factory flows for showers.	
Camps and Family Campgrounds	
Residential Camp (Semi-Permanent), per person	50
Campground with Central Sanitary Facilities, per person	35
Campground per Camp Space (Water and Sewer Hookups)	75
Day Camp, per person	15
Residential Institutions (Table 7 Application Rate)	
Hospital, per bed	250
Rest Home, per bed	150
Convalescent Home, per bed	150
Institution, per resident	100
Residential motels/hotels, per room	150
Group Home or Community Living Arrangement, per client ⁽⁴⁾	100-150 ⁽⁵⁾
(4) Use maximum occupancy unless state license restricts occupancy and requires DOH approval per PHC section 19-13-B100a for occupancy increases. (5) Use higher flow for large tub/on-site laundry.	
Restaurants, Food Establishments and Bars	
Restaurant/Retail Food Establishment per seat (Table 7 Application Rate)	30 ⁽⁶⁾
Takeout Food Service, per meal served (Table 7 Application Rate)	5
Bar/Cocktail Lounge (No meals), per seat (Table 8 Application Rate)	15
(6) Design flow shall be increased by 50% if breakfast, lunch, and dinner are provided.	
Banquet Facility or Gathering Venue	
Banquet Facility or Gathering Venue (Base Flow, Per Seat) (Table 8 Application Rate)	5
Additional Flows for On-Site Food Preparation, Bar Service, and Glassware and/or Tableware Washing (to be added to base flow per seating capacity) (Table 7 Application Rate)	
Bar or Drink Service Area	5
On-Site Food Preparation (commercial kitchen)	10
Glassware and/or Tableware Washing	5
Recreational Facilities	
Horse Stable, Per stall	50
Swimming pool, per bather	10

Building Type	Design Flow (GPD)
Tennis or Pickleball Court, per court: indoor/outdoor	400/150
Theater, Sport Complex, per seat	3.5
Church/Religious Building	
Worship Service, per seat	1
Sunday School, per pupil	2
Social Event (Meals served), per person (Table 7 Application Rate)	10
Miscellaneous	
Auto Service Station, per car serviced	5
Salon (Table 7 Application Rate),	
Per styling chair/station (hair)	200
Per pedicure chair/spa (5-gallon maximum basin)	100
Per manicure chair/station	50
Barber Shop, per chair	50
Dental/Medical Office with Examination Rooms, per SF of gross area	0.2
Dog Kennel, per run (Roof shall be provided) (Table 7 Application Rate)	25
Pet Grooming, per station (Table 7 Application Rate)	250
Laundromat (Non-DEEP Regulated), per machine (Table 7 Application Rate)	400
Motel (Transient; No Food Service, Kitchenette, or Laundry Facilities), per room	75
Motel (Transient; With Kitchenette but no Laundry Facilities), per room	100
Marina (Bathhouse and Showers Provided), per boat slip	20

7.3 Water Usage Monitoring

Proposed plans for approval for SSDSs serving a building or buildings with design flows between 2,000 to 10,000 GPD shall include provisions to determine sewage flows to SSDS(s) using water meters or other available means (e.g., pump cycling and dose volume documentation). Sewage flows shall be monitored to determine the flow to each SSDS if the building is served by more than 1 SSDS. Sewage flow information shall be made available upon request of the DOH.

7.4 Permits to Discharge

Permits to discharge for limited SSDS repairs (e.g., septic tank or leaching system replacement only) shall document which SSDS components were and were not replaced. The discharge permits shall specify the design flow and permitted flow. The design flow shall equal the permitted flow, except for leaching system repairs that do not provide the required ELA or MLSS. The permitted flow for non-compliant ELA or MLSS repairs shall be prorated by using the most limited % of the required ELA or MLSS provided. The discharge permit shall recommend the average daily discharge not exceed $\frac{2}{3}$ of the permitted flow to allow the SSDS to operate with a sufficient factor of safety and to accommodate peak flow conditions.

8. Septic Tanks and Grease Interceptor Tanks

8.1 Septic Tank General

SSDSs shall be provided with a septic tank made of concrete or other durable material. Septic tanks and grease interceptor tanks, including the riser and cover assemblies, located under vehicular travel areas shall be rated for H-20 wheel loadings, meaning a two-axle truck with a vehicle weight of 20 tons as designated for safety by the Connecticut Department of Transportation.

8.1.1 Concrete Septic Tanks

Concrete septic tanks shall be produced with a minimum 4,000-psi concrete with 4% to 7% air entrainment. Concrete septic tanks shall not be shipped until the concrete has reached the 4,000-psi compressive strength. Concrete septic tanks shipped prior to 14 days from the date of manufacture shall include documentation that the tank reached minimum strength prior to shipping. Concrete septic tank construction shall conform to the most current ASTM C 1227 standard with the following exceptions:

1. There shall be no maximum liquid depth.
2. The air space above the liquid level shall be a minimum of 8 inches.
3. Inspection ports over the compartment wall shall be optional.
4. The mid-depth connection can utilize a minimum 4 inch diameter pipe or mid-depth T-baffle connection.
5. Inlet and outlet pipe connections shall be watertight tank seals whenever the plan designer specifies such use.
6. Effluent filters do not have to meet the performance criteria of NSF/ANSI Standard 46.

Concrete septic tank pre-casters shall file tank specifications and drawings with the Commissioner along with certifications by a P.E. stating the tanks meet ASTM C 1227 specifications and the requirements of this section prior to distribution of tanks in Connecticut. The Commissioner shall maintain a list of approved concrete septic tank pre-casters that have met this requirement, which shall be posted on the Department's website.

8.1.2 Non-Concrete Septic Tanks

Non-concrete septic tanks shall meet all the applicable requirements set forth in sections 8.1.3 – 8.1.7 regarding tank configuration, access, and cleaning. Non-concrete tanks shall be marked with the manufacturer's name, tank designation number, size, and a "dangerous gas warning". Non-concrete septic tanks shall be installed with strict adherence to the manufacturer's installation instructions to avoid tank damage or deformation. Proper bedding and backfilling shall be confirmed with each tank installation. Shallow groundwater conditions may prohibit installation of certain tanks due to tank design limitations or warranty restrictions. Tank bottoms located below maximum groundwater levels shall be provided with anti-buoyancy/floatation provisions (check with

manufacturer). Non-concrete septic tanks shall meet the IAPMO/ANSI (International Association of Plumbing and Mechanical Officials/American National Standards Institute) Prefabricated Septic Tank Standard, unless otherwise approved by the Commissioner. Manufacturers of non-concrete septic tanks shall file and keep up-to-date specifications, technical support documentation, and dated installation instructions with the Commissioner. The Commissioner shall maintain a list of approved non-concrete septic tanks listed in Appendix C.

8.1.3 Septic Tank Configuration

The outlet invert of the septic tank shall be 3 inches lower than the inlet invert. Tanks shall be installed with the inlet invert between 2 and 4 inches above the outlet invert. Septic tanks shall have an inlet baffle submerged to a depth of 8 to 18 inches. Septic tanks shall have an outlet baffle submerged to a depth of at least 10 inches but no lower than 40% of the liquid depth, or an approved effluent filter specified in Appendix A. The inlet baffle shall encompass not more than 48 square inches of liquid surface area. All baffles shall extend a minimum of 5 inches above the tank's liquid level and provide a minimum 1 inch air gap above the baffle. Inlet and outlet piping entering and exiting the septic tank shall be as level as possible with a pitch no greater than $\frac{1}{4}$ inch per foot. Inlet and outlet piping shall be sealed with a sealed flexible joint connector. Inlet and outlet pipe seals shall be watertight tank seals when specified on the approved plan. Connection of piping and baffles made of dissimilar materials (e.g., PVC and PE) require the use of multi-purpose two-step solvent cement meeting ASTM D 3138. The minimum liquid depth of septic tanks shall be 36 inches.

All newly installed tanks shall have an approved non-bypass effluent filter that is rated for the design flow of the SSDS. Effluent filters shall provide a minimum of 45 square inches of total opening area.

8.1.4 Single Septic Tanks

A septic tank (except tanks in series) shall have 2 compartments with a minimum $\frac{2}{3}$ of the required capacity in the first compartment and a minimum $\frac{1}{3}$ of the required capacity in the second compartment (Figure 3). Compartment walls shall not extend to the interior roof without providing for venting. The transfer port shall be at mid-depth (opening in middle 25% of liquid depth). Mid-depth T-baffles like those shown in Figure 11 may be used as the mid-depth connection.

If any existing single compartment septic tank is to remain in use, the tank shall be evaluated to confirm they are in satisfactory condition and properly baffled. Proprietary leaching system companies may not support use of their products with single compartment septic tanks. The company shall be consulted if a repair plan includes their leaching system product with a single compartment septic tank.

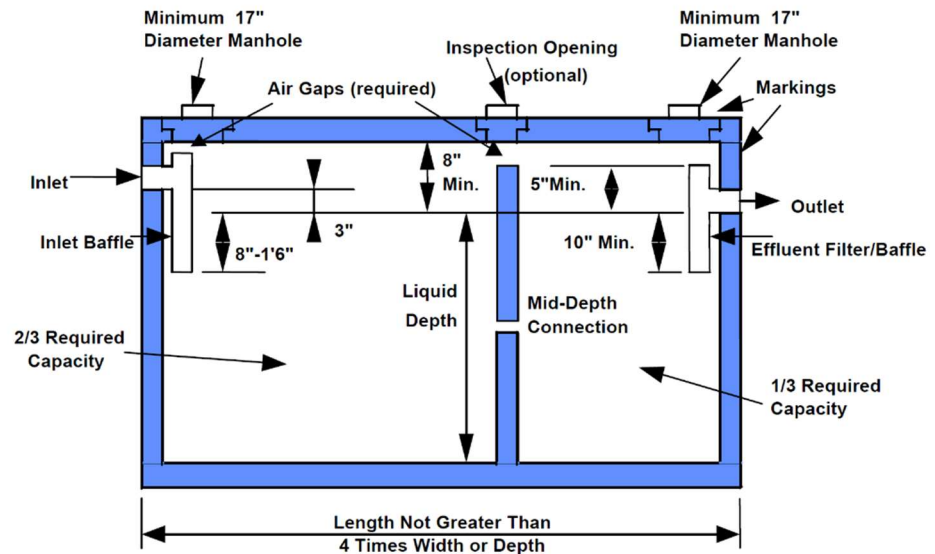


Figure 3. Typical Septic Tank Configuration

8.1.5 Multiple Septic Tanks in Series

The required septic tank capacity per section 8.2 may be obtained by utilizing multiple tanks in series, provided:

1. Each septic tank placed in series shall be of a single compartment design.
2. The minimum volumes of the first and second septic tanks shall be $\frac{2}{3}$ and $\frac{1}{3}$, respectively, of the required capacity. (Figure 4).
3. If the required capacity of the first tank exceeds 5,000 gallons, then the minimum volume of the first tank may be reduced to no less than 50% of the design flow per section 7.1 and 7.2.
4. The design flow must be provided within the volume of the first 2 tanks; additional tank(s) can be used to meet the required capacity per Table 5.
5. Mid-depth baffles shall be provided at the connection of the tanks.
6. An effluent filter shall be provided for the outlet of the last tank (Figure 4).

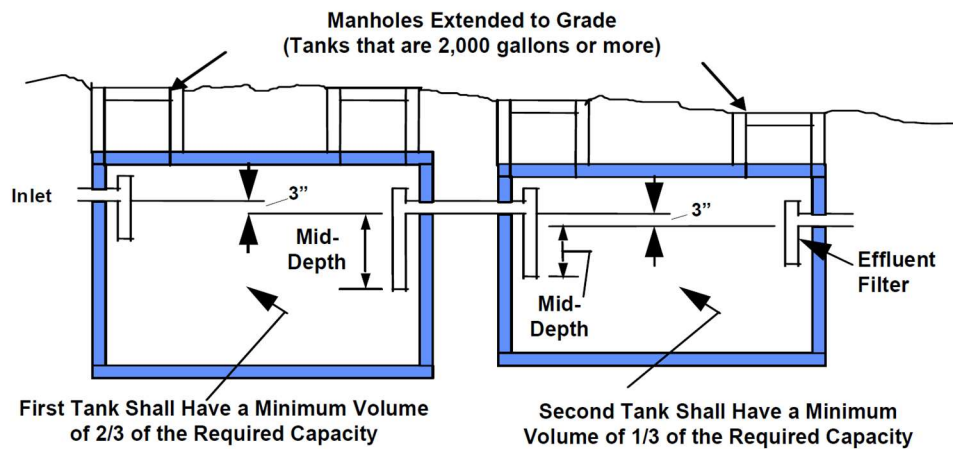


Figure 4. Two Septic Tanks in Series

8.1.6 Septic Tank Access

Septic tanks shall have removable manhole covers to provide access for inspection and cleaning. Cleanouts shall consist of a minimum 17 inch inside diameter opening and shall be located directly over the inlet baffle and effluent filter (Figure 5). Septic tanks shall have a minimum of 6 inches of cover. Cleanout manholes shall be located at a depth not greater than 12 inches below final grade. New and existing septic tanks that exceed the 12 inch depth shall be retrofitted with a cleanout riser(s); riser retrofits are not required for non-cleanout openings (e.g., baffle openings) unless the opening provides access to an effluent filter. New and existing septic tanks (without a riser) deeper than 24 inches below finish grade shall be provided with 24 inch minimum inside diameter access risers over each cleanout manhole opening. Riser cover assemblies shall be concrete or other durable material. If riser assemblies are utilized over cleanout openings, it is recommended that the covers be left on the tank for safety reasons, and to avoid potential odor problems. If a riser cover weighs less than 100 lbs., then the tank cover shall remain in place or a secondary safety lid or device shall be provided. It is recommended that secondary safety lids or devices be utilized for safety reasons even if the riser cover weighs 100 lbs. or greater. Secondary safety lids or devices must be installed per manufacturer specifications and shall be installed as shallow as possible to facilitate maintenance.

If a tank provides side inlets, the maximum distance between the interior wall surface and the cleanout manhole shall be 15 inches unless heavy-duty piping (Schedule 40, ASTM D 1785/2665) is used or the pipe inside the tank is supported. Baffle extensions shall not have more than a $\frac{1}{4}$ inch per foot pitch. Septic tank covers shall be stepped and provided with handles consisting of $\frac{3}{8}$ inch coated rebar or approved plastic handles. ASTM C 1227 also allows oversized non-stepped covers that sit on top of tanks if the covers are prevented from lateral movement. Approved concrete septic tank precasters making such tank covers shall provide documentation on lateral movement control provisions to the Commissioner. Below ground plastic handles and plastic riser covers cannot be used unless provisions are made to allow for manhole location with a metal detector. Septic tanks in

paved areas, and large (2,000 gallons or greater) septic tanks except for single-family residential buildings, shall have manholes extended to grade. Where covers are flush with or above grade, the lid shall weigh a minimum of 59 lbs., or the cover shall be provided with a lock system to prevent unauthorized entrance. Riser and manhole extensions to grade shall be designed and constructed to prevent storm water infiltration. Positive drainage away from manhole covers in paved areas shall be provided. Tanks that exceed 15 feet in length shall provide a minimum of 3 manholes. The overall length shall not be greater than 4 times either the width or the depth.

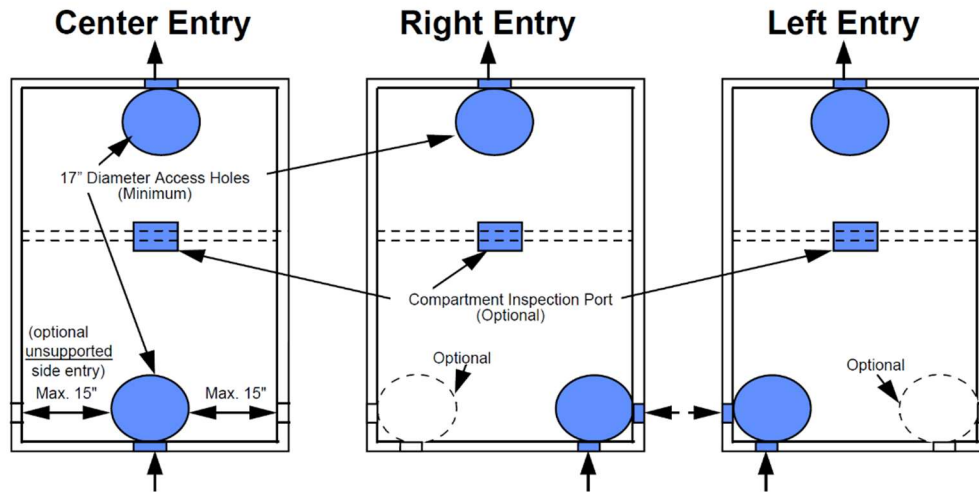


Figure 5. Standard Septic Tank Configurations

8.1.7 Septic Tank Cleaning

Septic tanks shall be cleaned (pumped-out) as often as necessary to prevent a buildup of sludge, grease and scum that will adversely affect the performance of the SSDS. Septic tanks shall be cleaned at regular intervals as dictated by the level of solids in the septic tank, typically every 3 to 5 years. Septic tanks shall be cleaned by first lowering the liquid level sufficiently below the outlet to prevent sludge or scum from overflowing to the leaching system where it could cause clogging and otherwise damage the system. Accidental spillages of sewage, sludge or scum shall be promptly removed or otherwise abated to prevent a nuisance or public health hazard.

Inlet and outlet baffles shall be inspected for damage or clogging at the time of tank cleaning/pumping. If provided, effluent filters shall be properly cleaned by rinsing the filter off with water directed back into the septic tank, or if water is not available, exchanged with a new effluent filter with the property owner's permission. Used effluent filters contain sewage and shall be handled in a sanitary manner during the cleaning or exchange process.

In a properly functioning system, wastewater shall not backflow from the leaching system into the septic tank during cleaning under normal use conditions, excluding large volume flood tests. Backflow indicates the leaching system is surcharged. Unless otherwise required by the DOH, tank pump-out reports issued by installers and cleaners shall document the presence of the backflow conditions and shall identify the system as "malfunctioning" at the time of cleaning. As with other malfunctioning system signs such as effluent overflowing the outlet baffle, back-up into building sewer or riser, an installer or cleaner issuing a pump-out report for a malfunctioning system shall include a recommendation in the report for a more in-depth assessment of system operation by an installer, unless the backflow condition is a result of a clogged effluent filter. Installers or cleaners shall identify SSDSs that discharge sewage onto the ground surface, into an open watercourse, or otherwise cause health hazards or nuisance conditions in the report as "failing". The DOH shall investigate such failures and require appropriate remedial action pursuant to PHC section 19-13-B103c(d).

8.1.8 Septic Tank Markings

Tank information (size, date manufactured, name of manufacturer, and indication of limit of external loads/cover depths required by section 13 of ASTM C 1227) shall be located on the top of the tank between the outlet access hole and outlet wall, or on the vertical outlet wall between the top of the tank and the top of the outlet opening. All septic tanks shall be manufactured with manhole covers or risers that have been placarded with notification of its 2-compartment construction and a warning that "Entrance into the tank could be fatal".

8.1.9 Septic Tank Performance Testing

Watertight tank seals shall be specified whenever tank watertightness is critical such as when infiltration into a pump chamber is a concern, or when a replacement septic tank is within the sanitary radius of a water supply well. Unless otherwise specified by the design P.E., plans or approvals requiring tank leakage testing shall utilize a vacuum test or water-pressure test in accordance with the following:

Vacuum Test: Assemble empty tank including temporary sealing of inlet and outlet pipes and all access openings. Attach a vacuum device that can draw a minimum vacuum pressure of 7 inches (175 mm) of mercury (Hg). To measure negative pressure drawn, the vacuum device shall utilize a calibrated gauge (range no greater than 0-10 inches/Hg), mercury manometer, or water manometer accurate to within 0.2 inches/Hg. Apply a vacuum to 4 inches (100 mm)/Hg. Tank passes leakage test once the tank holds the negative pressure for 5 minutes without loss of pressure. If the tank is unable to hold the required pressure for 5 minutes, then the tank can be repaired per manufacturer's recommendations and retested. Installed tanks can also be vacuumed tested prior to backfill in accordance with ASTM C 1719 to ensure water tightness.

Water-Pressure Test: Seal the tank. Fill with water and let stand for 24 hours. Refill the tank. The tank passes the leakage test if the water level is held for 1 hour.

8.2 Septic Tank Sizing

8.2.1 Residential Buildings

The required capacity (volume) of a septic tank serving a residential building shall be based on Table 5. Septic tank sizing for a central SSDS serving a single-family residential building and an outbuilding containing a potential bedroom(s) shall calculate the minimum required septic tank capacity based on the single-family criteria for the main dwelling and an additional 225 gallons for each bedroom in the outbuilding. For a single-family home with an attached or internal accessory apartment, the minimum required tank capacity shall be calculated based on the single-family criteria for the main dwelling and an additional 225 gallons for each bedroom in the accessory apartment.

Table 5. Septic Tank Sizing for Residential Buildings

Number of Bedrooms	Single-Family	Multi-Family
1-3 Bedrooms	1,000 Gallons	1,250 Gallons
Each Bedroom Above 3	Add 125 Gallons per Bedroom	Add 225 Gallons per Bedroom
Each Bedroom Above 15	Add 125 Gallons per Bedroom	Add 150 Gallons per Bedroom

8.2.2 Non-residential Buildings and Residential Institutions

The required capacity of a septic tank serving a non-residential building or a residential institution shall be a minimum of 1,000 gallons or the design flow per section 7, whichever is greater. A building generating a high peak flow shall have a septic tank providing a minimum detention time of 2 hours under peak flow conditions. The detention time is the tank liquid volume divided by the flow rate through the tank. The required septic tank capacity shall be increased by a minimum of 50% at a food establishment or restaurant for a repair or replacement of an existing SSDS where it is determined that it is not feasible to install a grease interceptor tank or internal automatic grease recovery unit (AGRU).

8.2.3 Raw Sewage Pumps: Septic Tank Additional Sizing

Whenever more than 25% of the building's design flow is pumped into the septic tank, the size of the tank shall be increased 50% beyond the minimum capacity required per sections 8.2.1 and 8.2.2.

8.2.4 Garbage Grinders, Large Bathtubs, and Water Treatment Wastewater: Septic Tank Additional Sizing

Garbage grinders are not recommended for use with SSDSs. Only certain water treatment wastewater (WTW) is authorized to discharge to a SSDS (refer to section 16 and Appendix D for WTW discharge requirements). The minimum liquid capacity of a septic tank shall be increased whenever a building contains a garbage grinder, large capacity bathtub, or WTW is discharged to the SSDS in accordance with the following:

Fixture	Increase Tank Capacity (Gallons)
Garbage Grinder	Add 250
Large Bathtub (100-200 gallons)	Add 250
Large Bathtub (Over 200 gallons)	Add 500
WTW (Discharges of 50-150 gallons per cycle)	Add 250
WTW (Discharges Over 150 gallons per cycle)	Add 500

8.3 Grease Interceptor Tanks

Grease interceptor tanks (GITs) shall be provided for restaurants and food establishments with design flows of 500 GPD or greater for new construction and repairs of existing SSDSs where feasible. If it is not feasible to install a GIT for a food establishment or restaurant SSDS repair, an internal AGRU is recommended for the wastewater piping in the kitchen. If a GIT or an internal AGRU is not included in a food establishment restaurant SSDS repair, then the required septic tank capacity shall be increased by 50% (section 8.2.2).

GITs shall receive wastewater from the kitchen waste lines only. Effluent discharged from the GIT shall be directed to the inlet end of the septic tank. The liquid capacity of GITs shall be a minimum of 1,000 gallons or the design flow, whichever is greater. For restaurants and food establishments with design flows of 2,000 GPD or greater, 2 GITs in series shall be provided with a combined liquid volume meeting or surpassing the design flow. Grease Interceptor Tanks used in series should be of similar sizes. GITs shall have inlet and outlet baffles that extend to a depth of 6 to 12 inches above the tank bottom (Figure 6) and extend at least 5 inches above the liquid level. Effluent filters are not required on GITs, but they can be used if the manufacturer of the filter specifies that it is suitable for such use. All manholes over GIT cleanouts shall be watertight and extended to grade to facilitate cleaning. Positive drainage away from manhole covers in paved areas shall be provided.

8.3.1 Access Riser Requirements

GIT tanks deeper than 24 inches below finish grade shall be provided with large (24 inch minimum inside diameter) access risers over each cleanout manhole opening. GITs shall be provided with manhole covers that

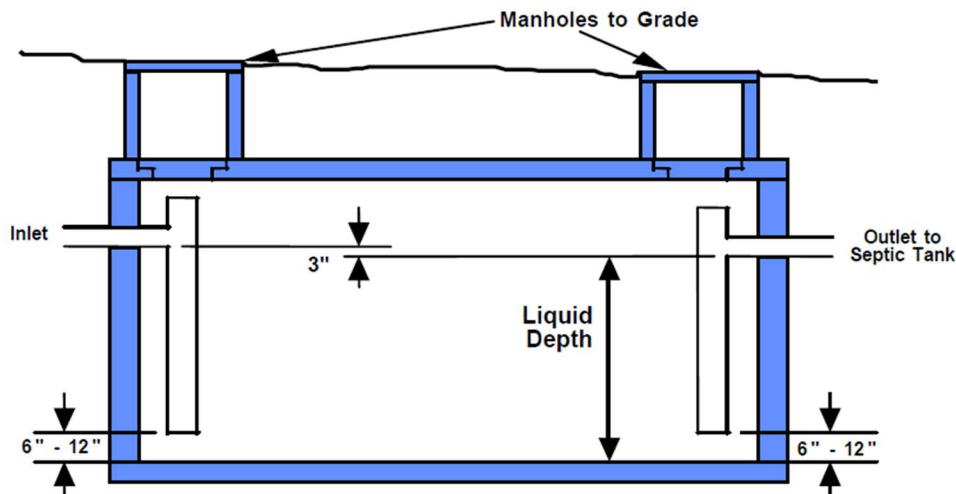


Figure 6. Grease Interceptor Tank (GIT)

have been placarded with notification as to the danger of entering the tank due to noxious gases. Covers to grade shall weigh a minimum of 59 lbs. or the cover shall be provided with a lock system to prevent unauthorized entrance. If riser assemblies are utilized over cleanout openings, it is recommended that the covers be left on the tank for safety reasons, and to avoid potential odor problems. If a riser cover weighs less than 100 lbs., then the tank cover shall remain in place or a secondary safety lid or device shall be provided. It is recommended that secondary safety lids or devices be utilized for safety reasons even if the riser cover weighs 100 lbs. or greater. Secondary safety lids or devices must be installed per manufacturer specifications and should be installed as shallow as possible to facilitate maintenance.

8.3.2 Construction and Marking Requirements

Required GITs can be single compartment or 2-compartment tanks and shall be constructed out of concrete or other durable material. Concrete GITs shall meet all structural and access requirements for concrete septic tanks. This includes applicable configuration (pipe seals, inlet/outlet differential, etc.) and access requirements (riser sizes, stepped covers, etc.) consistent with the requirements for concrete septic tanks. Concrete GITs shall be marked with tank information (size, name of manufacturer, date manufactured, loading limits), and be subject to other applicable septic tank provisions (performance testing, cleaning, tank abandonment, etc.). Non-concrete GITs shall also meet the requirements for concrete GITs excluding the structural and marking requirements. Non-concrete GITs shall be marked with the manufacturer's name, designation number, size, and a "dangerous gas warning". The Commissioner may approve non-concrete GITs. Some manufacturers of plastic septic tanks do not authorize their tanks be used as GITs due to the high temperature of the wastewater.

9. Effluent Distribution and Pump Systems

9.1 General

Distribution of septic tank effluent to a leaching system shall promote uniform distribution and full utilization of the system, and can be accomplished by gravity, pump, siphon, or dosing method approved by the Commissioner. Approved dosing methods include the Rissy Plastics Floating Outlet Distribution Chamber, Premier Plastics Flout Dosing Tanks, and the Geomatrix HyAir Pump System. Leaching systems shall be designed to prevent effluent backflow into the septic tank. The septic tank outlet invert shall be set no lower than 3 inches from the top of all leaching structures (except in pump systems), or in the case of leaching systems utilizing serial distribution, higher than the high-level overflow elevation of the upper most leaching system row. The effluent distribution piping between the septic tank and a leaching system shall not have negative pitch. It is recommended that SSDSs be designed to allow for gas and air transfer from the leaching system back through the septic tank and building vents. Fully flooded distribution boxes should be avoided, and it is recommended that distribution piping/boxes be designed so that there is an air space in all pipes during normal leaching system operation. Leaching systems designed for serial distribution shall be designed so that the high-level overflow invert elevations are within the top 3 inches (0.25 feet) of the leaching structure. It is noted that gas and air transfer can be limited in serial distribution systems. Providing holes in the top portion of perforated effluent distribution pipe above the high-level overflow elevation can promote gas transfer.

9.1.1 Access Points

Leaching systems shall include access points consisting of distribution boxes, cleanouts (galleries, pits), or capped sanitary tees. Leaching system access points on large and non-residential SSDSs in paved areas shall be provided with H-20 load rated risers to grade. At least one access point shall be provided for each leaching system row. A single distribution box feeding row segments at the same elevation on either side of the distribution box shall constitute access points for both row segments. Leaching systems with rows at the same elevation shall have ends connected wherever feasible (Figure 7). Non-level leaching systems may apply effluent by dosing (pump, siphon, approved method), serial distribution with high-level overflow (Figures 8 and 9), or by approved effluent splitting devices (e.g., Polylok Dipper D-Box, Equalizer pipe inserts, Zoeller Tru Flow D-box).

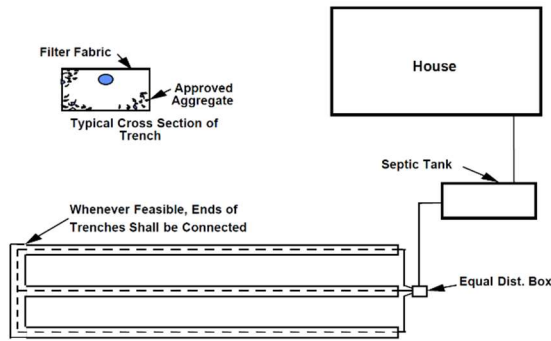


Figure 7. Level Leaching Systems



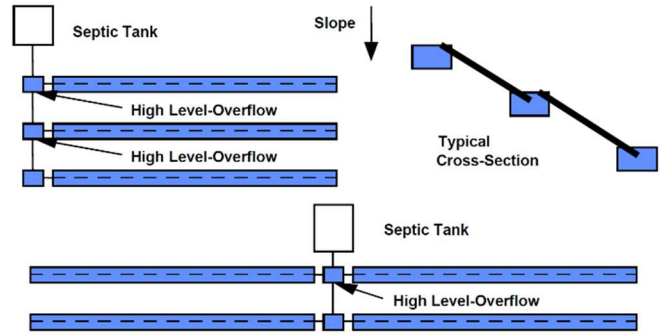


Figure 8. Serial Distribution Systems

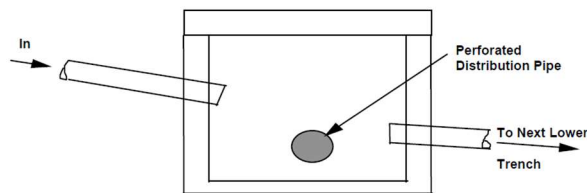

High - Level Overflow Dist. Box

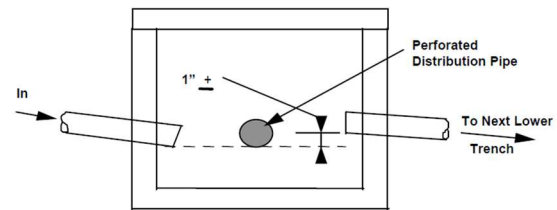

Reversed Distribution Box

Note: The high-level overflow invert elevation shall be set within the top 3 inches of the upper leaching system row. The use of reversed distribution boxes shall be avoided if gas venting is restricted.

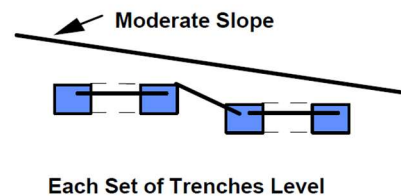
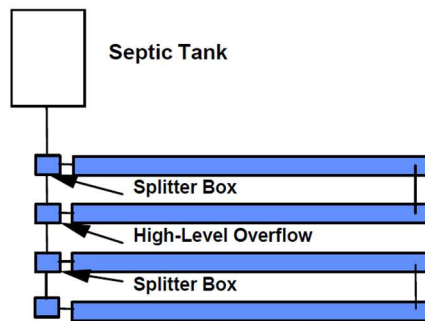


Figure 9. Alternative Distribution Systems and D-Box Configurations

9.2 Mandatory Dosing

Large SSDS with more than 600 LF of leaching system shall utilize intermittent dosing arrangements. Dosing can be accomplished by pump, siphon, or other approved method. Dosing systems shall be designed to dose the leaching system at a frequency of 3 to 6 cycles per day unless timed dosing is utilized. Dosing chambers shall have access manholes to grade. Large SSDS utilizing pump systems shall be designed with duplicate alternating pumps. Alternating pump and siphon systems shall be designed to provide full leaching system utilization in the event one of the pumps or siphons fails to operate.

9.3 Pump Systems

9.3.1 Effluent Pump Chamber General

Effluent pump chambers shall be provided with watertight risers/manholes to grade and high-level alarms. The alarm shall be both audible and visual, unless otherwise approved by the DOH, and be located so that it readily alerts building occupants when activated. Existing pump chambers shall be retrofitted with risers to grade if not currently provided. Pump chambers 1000 gallons or larger shall provide 24 inch minimum inside diameter risers over access manholes. Covers to grade shall weigh a minimum of 59 lbs. or the cover shall be provided with a lock system to prevent unauthorized entrance. If a riser cover weighs less than 100 lbs., a secondary safety lid or device shall be provided. It is recommended that secondary safety lids or devices be utilized for safety reasons even if the riser cover weighs 100 lbs. or greater. Secondary safety lids or devices must be installed per manufacturer specifications and should be installed as shallow as possible to facilitate maintenance.

Effluent pumps shall be approved by the manufacturer for use in SSDSs. Force mains shall be freeze protected by burying the pipe below the frost line, allowing back drainage into the pump chamber through a weep hole, or other acceptable means (e.g., insulation). Back siphonage from the leaching system and/or excessive pump cycling shall be avoided when a weep hole is provided. Pump chambers in shallow groundwater areas shall utilize watertight tank seals and should be tested for leakage to ensure water tightness.

When a pump chamber is utilized for a small SSDS (< 2,000 GPD), it shall be provided with either duplicate alternating pumps, or a single pump and have a minimum emergency storage volume equal to the daily design flow. Emergency storage volume is measured from the alarm level to the inlet pipe invert (Figure 10).

9.3.2 Pump Chamber Specifications

Specifications shall be provided for all the internal components of the pump chamber (e.g., pumps, piping, floats, transducers, alarms, disconnect chain, valves). Pump on/off levels and alarm level shall be specified along with the dose volume and emergency storage provided. Pump systems can utilize pressure transducers, mechanical float switches, or other acceptable controls. The sale of mercury float switches is banned in Connecticut. The pump shall be rated to handle the design flow rate at the total dynamic head for the installation. A check valve shall be provided on the pump discharge line unless the pump manufacturer does not require one. Check valve and weep hole locations shown in Figure 10 are for illustrative purposes only; actual locations shall be established by the SSDS designer. Pipe union, lift chain and manhole location shall allow for convenient pump removal for routine maintenance, and electrical and pump connections shall be readily accessible from the ground surface. Piping attached to the pump shall be set close enough to the top of the chamber under the manhole to allow for servicing, and a quick-disconnect device shall be utilized to allow for easy removal of the pump for maintenance. Internal pump chamber appurtenances shall be non-corrosive and suitable for the corrosive effluent environment. Electrical work for pump systems and alarms requires a permit from the local building official. The use of detectable underground magnetic tracer or warning tape is recommended to be provided at least 1 foot above buried electric lines within 25 feet of the SSDS.

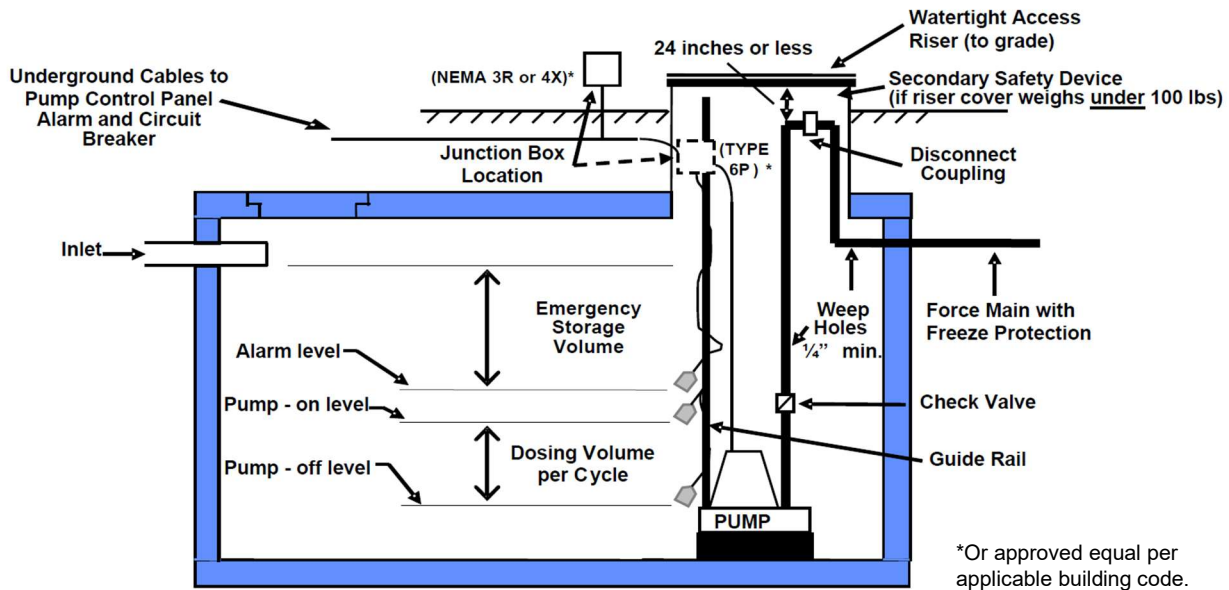


Figure 10. Pump Chamber

9.3.3 Low-Pressure Distribution (LPD)

LPD used in conjunction with leaching trenches, leaching galleries, and proprietary leaching systems require a design by a P.E., unless the leaching system manufacturer applies for and receives approval from the Commissioner for non-P.E. designed LPD arrangements that can be used with their systems. Leaching system manufacturers requesting such approval shall file supporting documentation with the Commissioner that details their standardized LPD design, and approval for a leaching system manufacturer's non-P.E. LPD design can be granted if a determination is made that the dosing system is sufficiently detailed and designed so that a P.E. design is not warranted. P.E. designs of LPD systems shall include access and flushing provisions for the purpose of routine maintenance and checking pressure in the lines, and provisions shall be provided for flow adjustment to the distribution lines. LPD designs shall provide system details on pressure filters, orifice shields, manifold access, and pipe (size, specifications, diameter and spacing of piping holes) and pump information. The LPD designer shall specify operations and maintenance requirements for the system (e.g., flushing of the lines, checking pressure heads).

9.3.4 Passive Nitrogen Reduction (PNR)

PNR technology may be utilized in conjunction with a SSDS installation that utilizes LPD or a proprietary pressure-dosed dispersal (PPD) system. PNR technology does not aerate the contents of the septic tank and only uses a single pump or dual alternating pumps for LPD or the PPD system. PNR technology uses a clean subsurface wood product (e.g., sawdust, wood chips, mulch) through which partially treated sewage effluent flows. The wood product may be installed within a saturated or unsaturated soil treatment environment. The wood product provides a carbon source for denitrification of nitrified wastewater below or downgradient of a leaching system.

9.3.4.1 Design and Installation Controls

Successful use of PNR technology requires strict design and installation controls to ensure it doesn't interfere with the proper operation of the SSDS. PNR technology is relatively new, and its use should be limited until such time that standardized design criterion is established. PNR technology use shall be limited to areas where nitrogen pollution from on-site sewage systems is a concern, such as high-density residential development areas under community pollution abatement orders. PNR technology should only be permitted if the DOH has determined that its usage is appropriate, and the DOH has sufficient resources to ensure the systems are properly designed and installed.

9.3.4.2. Detailed Plans and Notification

SSDS designs that include PNR technology must have detailed plans that include information and specifications on the dosing system, wood product, and soil treatment horizons. Typically, PNR technology mixes wood product with a specified category of clean soil (e.g., sand, loamy sand). Plans must provide a plan view and cross sections detailing the leaching system, wood product, added soil, restrictive layers, and all pertinent depths and elevations. Plans must include media placement and construction requirements, and information on any monitoring mechanisms. The DOH shall require the plan designer of a SSDS that includes PNR technology to supervise installation of the system and provide a written certification that the system was installed in conformance with the approved plan.

The use of PNR technology requires that the DOH provide the Commissioner notice of proposed installations on small SSDSs prior to issuance of an approval to construct. This will allow for a determination to be made if the system may be classified as an alternative treatment system, which can only be permitted by the Department of Energy and Environmental Protection. Notice is not required for large SSDSs as plans for these systems require approval from the Commissioner.

9.3.5 Raw Sewage Pumps

Raw sewage pumps are not recommended for use with SSDSs; however, when unable to obtain gravity flow to the septic tank, solids handling pumps (ejector) are preferred over grinder pumps. If raw sewage pumps are needed for basement fixtures, upper floor flows should be directed to the septic tank by gravity where feasible. In the event more than 25% of the design flow is pumped to the septic tank, the required septic tank capacity shall be increased by 50% (section 8.2.3). Force main foundation penetrations shall comply with the plumbing code, which is under the purview of the local building official. A raw sewage pump located outside a building is considered part of the SSDS and shall be installed in compliance with the separation distances in Table 1. Raw sewage pumps/vaults below a building's slab elevation are considered outside the building unless they are installed in a sealed pit or otherwise designed to contain potential leakage inside the building. Exterior raw sewage pump vaults shall have an access opening to grade and be equipped with a malfunction alarm. Exterior raw sewage pump vaults that serve buildings, other than outbuildings, shall have dual alternating pumps or provide 24-hour emergency storage for the design flow they handle if the building's occupants only have access to bathroom facilities that rely on the raw sewage pump vault for its operation. A raw sewage pump force main shall discharge to the septic tank via a 4-inch pipe connection to reduce velocity and solids disturbance. An inlet baffle is required for the tank at the force main connection.

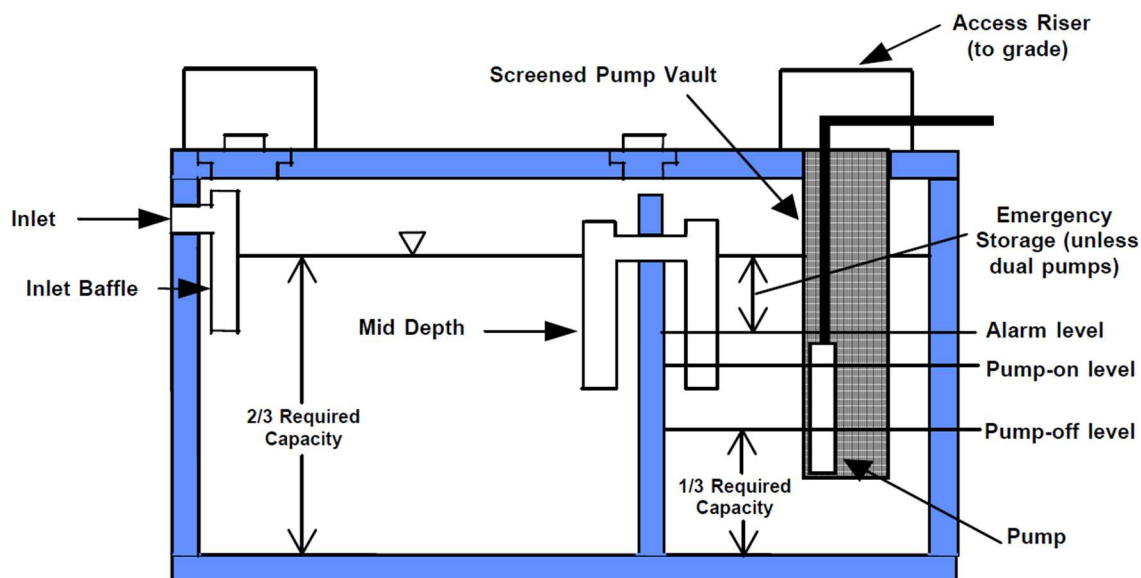


Figure 11. Combination Septic Tank/Pump System with Tee Baffle Connection

9.3.6 Combination Septic Tank and Pump Systems

Combination septic tank/pump systems may be utilized in instances where space constraints, site limitations or other technical justification make it advantageous to install a single tank/pump unit. Combination septic tank/pump systems shall utilize a screened pump vault designed for that application, which is installed in the second compartment of an oversized 2-compartment septic tank. The combination tank shall be sized to provide 24-hour emergency storage if a single pump is utilized. The tank liquid level should only draw down in the second compartment; however limited draw down in both chambers may be included in the SSDS design if the pump manufacturer authorizes such practice. Use of mid-liquid depth tee baffles with a compartment connection pipe at the liquid level shall be utilized to draw down effluent in second compartment only (Figure 11). The required septic tank capacity shall be provided below the "pump-off" level.

10. Percolation Tests

10.1 General

A percolation test (often called a "perc test") shall have the same meaning as used in PHC section 19-13-B103b. A percolation test consists of 3 steps: 1) presoaking the percolation hole, 2) refilling and allowing the hole to saturate under certain conditions, and 3) determining the minimum uniform percolation rate after saturation. The purpose of the presoak is to allow sufficient soil-water contact time. During the presoak, swelling clays that may be present in the soil will expand thereby reducing the void space. Sufficient presoaking allows the advancing capillary wetting front, which controls the water flow rate in unsaturated soils, to move away from the test hole so that a uniform flow rate is reached. Percolation tests shall be avoided when the ground is saturated from heavy rain/flooding, or a frost layer exists.

10.1.1 Placement

Percolation tests shall be performed in 6 to 12-inch diameter holes dug into the receiving soil to establish the percolation rate for determining ELA (section 12) and percolation factor for MLSS purposes (section 13). Percolation holes shall be at the depth of the proposed leaching system to establish the percolation rate for sizing purposes. If fill material or disturbed naturally occurring soil is the receiving soil, several percolation tests shall be conducted to establish the percolation rate as the rate may vary widely, and to determine whether soil replacement is necessary. Leaching systems that are located entirely in select fill require additional percolation tests after select fill placement to confirm the percolation rate of the select fill is not slower than the design rate. When receiving soil contains distinct soil strata of different texture or structure, each stratum shall be tested separately with holes at relative depths. In calculating the required leaching area (primary and reserve), only representative test results in the area and at the depth of the proposed leaching system shall be used, however all tests shall be reported.

10.1.2. Procedures

Presoaking shall be started by filling the hole with a 12-inch depth of water. If the water seeps away in less than 2 hours, the hole may be refilled to a 12-inch depth and the percolation test begun. If water remains after 2 hours, the hole shall be refilled to a 12-inch depth and allowed to presoak for 2 additional hours before starting the percolation test, unless the soil contains little clay. Holes that contain water for at least 4 hours shall be considered presoaked. Tests performed immediately after the presoak period yield more accurate results. If more than 30 hours have elapsed following the initial presoak, the test hole shall be presoaked once again. Following the presoak, the hole shall be refilled with 12 inches of water to begin percolation test. Water level readings shall be recorded at regular intervals and shall continue until there is 2 to 3 inches of water remaining in the hole. Additional readings may not accurately reflect the percolation rate as fine soil particles may accumulate at the bottom portion of the hole. The minimum uniform percolation rate following saturation shall be used to calculate the size of the leaching system.

10.1.3. Leaching System Constructed Entirely in Select Fill

If a leaching system is constructed entirely in select fill and the bottom of the system is above original grade, then the required ELA may be determined based on the percolation rate of the select fill. Using a percolation rate faster than 10.1 minutes per inch may be problematic if the percolation rate in the select fill is determined to be slower; it

is suggested to use a conservative design percolation rate of 10.1 to 20.0 minutes per inch. Although the required ELA may be determined by the percolation rate of the select fill, the MLSS shall be based on the percolation rate of the receiving soil that may be considerably slower.

11. Leaching Systems

11.1 General

11.1.1 Minimum Separating Distances Above Ledge Rock and Maximum Groundwater

Leaching systems shall not be constructed in areas where high groundwater, surface flooding or ledge rock will interfere with its operation. Leaching systems shall be installed as shallow as possible and preferably not under parking or vehicular travel areas. The maximum depth of the bottom of a leaching system below finished grade shall be 8 feet. The maximum width of leaching products (e.g., trenches, galleries, proprietary systems) is 6.5 feet, except for leaching pits. Entering deep test pits above the waist may result in bodily harm or death in the event of cave in. Use of shallow shelves is recommended to allow for assessment of the soil in the upper profile of the pit. Refer to OSHA standards for pit safety measures and restrictions. Site investigation documentation shall be recorded on Form #2 or Form #2 Alternate.

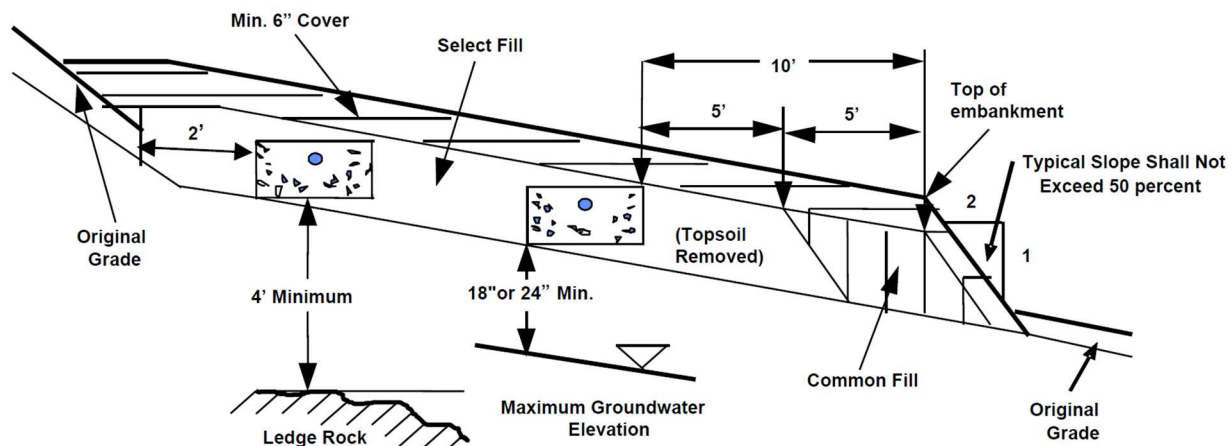


Figure 12. Minimum Separating Distances Above Ledge Rock and Maximum Groundwater

The bottom of a leaching system shall be a minimum 18 inches above maximum groundwater and 4 feet above ledge rock. Additional separation shall be provided as follows:

1. If the receiving soil percolation rate is faster than 5.0 minutes per inch, the minimum separation to maximum groundwater shall be increased to 24 inches.
2. If the receiving soil percolation rate is faster than 1.0 minute per inch, the minimum separation above ledge rock shall be increased to 8 feet or the distances shall be doubled from any water supply well in accordance with the special provisions in Table 1 (Item A).
3. Large SSDSs shall provide a minimum 24 inches of separation above maximum groundwater.
4. SSDSs in coastal areas on sites with tidally impacted groundwater tables shall provide a minimum 24 inches above maximum groundwater. Maximum groundwater determinations in coastal areas shall consider water level rise associated with tide changes.

11.1.2 Minimum Leaching System Spread (MLSS)

Plans for new SSDSs, code-complying areas, designated leaching system areas for proposed lots, and repairs of existing leaching systems shall demonstrate compliance with the Minimum Leaching System Spread (MLSS) requirements in section 13. Exceptions to MLSS compliance shall only be granted for SSDS repairs, and a reduced flow per section 7.4 shall be cited on the Permit to Discharge for non-compliant repairs. MLSS is not applicable on sites when receiving soil depth is greater than 60 inches, or when a P.E. has assessed the hydraulic

capacity of the receiving soil, or for reserve leaching areas. It is recommended that reserve leaching areas comply with MLSS. SSDSs on sites with a receiving soil depth (RS Depth) of less than 18 inches shall require a P.E. hydraulic analysis of the receiving soil.

The length of leaching trench, gallery or proprietary leaching system row segments shall not exceed 75 feet measured from the inlet. In installations where intermittent dosing (e.g., pumping) exceeding 25 gallons/cycle is used a maximum length of 100 feet may be utilized.

11.1.3 Naturally Occurring Soil

New SSDSs are required to have naturally occurring receiving soil that originates at the site. Naturally occurring soil is defined in PHC section 19-13-B013b. Repairs of existing SSDSs may use fill material as receiving soil if sufficient naturally occurring soil is not available. Plans for a new SSDS shall not be denied based on MLSS non-compliance but shall be denied if compliance with PHC section 19-13-B103e(a)(4) is not demonstrated. This regulation prohibits approval of a new SSDS when the surrounding naturally occurring soil cannot adequately absorb or disperse the expected volume of sewage effluent without overflow, breakout, or detrimental effect on ground or surface water. Approval of new SSDSs on sites with less than 18 inches of naturally occurring soil shall not be considered unless a P.E. satisfactorily demonstrates through a hydraulic analysis or loading test that the naturally occurring soil can disperse the design flow. Sites without any unsaturated naturally occurring soil are not candidates for a hydraulic assessment since the naturally occurring soil is already in an overflowed/saturated condition.

11.1.4 Soil Conditions

Suitable soil is defined in PHC section 19-13-B103b. Leaching system areas for new SSDSs and code-complying area designations shall not contain unsuitable soil conditions. The leaching system area includes soil within 10 feet in all directions around the perimeter of the leaching system. Unsuitable soil conditions include areas with less than 18 inches of soil above maximum groundwater or less than 4 feet of soil above ledge rock. Ledge rock lots with a minimum of 2 feet of naturally occurring soil that are to be filled to address unsuitable soil conditions shall be prepared with the necessary select fill needed for the leaching system installation in a manner to protect the naturally occurring soil and be stabilized to protect against erosion.

11.1.5 Reserve Leaching Areas

New SSDSs constructed in areas where there is no definite schedule for the extension of public sewers within 5 years shall provide an acceptable reserve leaching area of potentially suitable soil. Potentially suitable soil contains at least 2 feet of naturally occurring soil over ledge rock. Reserve leaching areas shall be sized based on percolation rate and have the feasibility to be constructed in conformance with all aspects of the PHC and Technical Standards, except MLSS, for the purpose of expansion or replacement of the primary leaching system. Reserve leaching areas are not required for repairs of existing leaching systems, or for outbuildings with a design flow of 150 GPD or less on single-family residential building lots. A reserve leaching area exists during the construction phase of a new system installation and does not need to be maintained beyond the issuance of a permit to discharge.

11.1.6 Non-linear Level Leaching Systems

Non-linear level leaching systems (e.g., interconnecting end sections, L-shaped, U-shaped, Box shaped) may be credited in certain instances. However, the length of the main row(s) shall only be measured to the center of the interconnecting segment or extension. Leaching systems shall not receive credit for such configurations unless MLSS is not applicable, or the groundwater hydraulic gradient is level (0% slope). Non-linear leaching system configurations may present a concern for non-uniform effluent loading on MLSS applicable sites with sloped hydraulic gradients.

11.1.7 Vehicle Loading Requirements

Leaching systems located in vehicular travel areas shall be capable of handling H-20 wheel loads as follows:

1. Precast concrete structures (galleries, pits) shall be H-20 load rated.

2. Leaching trenches shall have a minimum 1 foot cover.
3. Proprietary leaching systems shall only be used in vehicular travel areas if authorized by the manufacturer and shall be H-20 load rated. Proprietary leaching system companies authorizing placement of their systems in vehicular travel areas shall file supporting documentation with the Commissioner.

11.1.8 Retaining Walls

SSDS designs that include retaining walls shall provide information and specifications for the retaining wall including its foundation, and any associated groundwater control mechanisms (drains, weep holes). A cross-section of the wall showing existing and proposed grades shall be provided. Retaining wall groundwater drains shall comply with the minimum separating distances listed in Table 1 (Item G). Retaining walls within 50 feet down-gradient of a leaching system shall not act as a hydraulic barrier to groundwater and wastewater movement in the receiving soil. The inner edge of the retaining wall shall be at least 10 feet from the leaching system. Retaining walls shall be designed to prevent seepage from occurring through the above grade portions of the wall.

11.1.9 Leaching Row Center to Center Spacing

The minimum specified center to center (C to C) spacing is required between leaching rows. C to C spacing is also applicable for the primary system relative to the reserve system. Whenever 2 different types of leaching products are utilized side-by-side, the average of the required minimum C to C spacing shall be maintained.

11.1.10 Filter Fabric

A layer of non-woven filter fabric shall be placed over leaching system approved aggregate, and over exposed leaching gallery section joints prior to backfilling. Minimum average roll values for fabric used for covering stone aggregate shall have a unit weight of 1.5 oz./yd² (per ASTM D 5261), a permittivity of 1.0 sec⁻¹ (per ASTM D 4491) and a trapezoid tear strength of 15 lbs. (per ASTM D 4533). Filter fabric covering approved aggregate, except fabric with a P.E. certification, shall bear the appropriate manufacturer's label specifying the product's name and identification number. Labeling shall be affixed in such a manner to be readily visible to facilitate inspection. The Commissioner shall maintain a list of approved filter fabrics in Appendix B. P.E. certification of unlabeled fabric shall be made only by the plan designer, and fabric information and specifications shall be included on the design plan. The P.E. shall certify the fabric meets the above noted minimum average roll values and shall inspect the leaching system before covering and confirm in a written statement to the DOH that the specified fabric was utilized.

11.1.11 Stone Aggregate

Stone aggregate must be of uniform consistency and only contain clean, hard, durable fragments that meet the specifications cited in the stone aggregate definition (section 4), which includes a fines standard of a maximum of 1% passing the No. 200 sieve at the pit/quarry source. This standard shall also be met at the SSDS installation site; however, in no case shall the fines exceed 1.5%. Stone aggregate utilized in leaching system installations shall meet the following gradations for either #4 stone aggregate or #6 stone aggregate, respectively:

	#4 Stone Aggregate (A.K.A., 1 and 1/4" Stone)	#6 Stone Aggregate (A.K.A., 3/4" Stone)
SIEVE SIZE	% PASSING (by weight)	% PASSING (by weight)
2-inch	100	N/A
1.5-inch	90 – 100	N/A
1-inch	20 – 55	100
3/4-inch	0 – 15	90 - 100
1/2-inch	N/A	20 - 55
3/8-inch	0 – 5	0 - 15
#4	N/A	0 - 5

11.1.12 Select Fill

Select fill placed within and adjacent to leaching system areas shall be a clean material comprised of sand, or sand and gravel, free from organic matter and foreign substances. Select fill shall meet the following requirements unless otherwise approved by the design P.E.:

1. The select fill shall not contain any material larger than the 3 inch sieve.
2. Up to 45% of the dry weight of the representative sample may be retained (gravel portion) on the #4 sieve.
3. The material that passes the #4 sieve is then reweighed and the sieve analysis started.
4. The remaining sample shall meet the following gradation criteria:

SIEVE SIZE	% PASSING	
	WET SIEVE	DRY SIEVE ⁽¹⁾
#4	100	100
#10	70 - 100	70 - 100
#40	10 - 50 ⁽²⁾	10 - 75
#100	0 - 20	0 - 5
#200	0 - 5 ⁽³⁾	0 - 2.5

⁽¹⁾ Select fill that does not meet the dry sieve gradation criteria but meets the wet sieve gradation criteria is acceptable.

⁽²⁾ % passing the #40 sieve may be increased to no greater than 75 if the % passing the #100 sieve does not exceed 10 and the #200 sieve does not exceed 5.

⁽³⁾ Select fill exceeding 6% passing the #200 sieve based on a wet sieve analysis shall not be approved by the design P.E.

Sieve testing of select fill is required for large SSDSs whenever the leaching system is located entirely in select fill. The DOH may require sieve testing of select fill, including on-site sieve testing, in accordance with PHC Section 19-13-B103e(c)(6).

11.1.12.1 ASTM C 33 Sand

Several proprietary leaching products require use of ASTM C 33 sand or washed sand meeting DOT Form 817 Table M.03.01-1 for fine aggregates. ASTM C 33 sand and DOT washed sand contains no medium and large ($\frac{3}{8}$ " to 3") gravel and limited (less than 5% percent) small (#4 sieve to $\frac{3}{8}$ ") gravel. Sand specified for the infiltrative interface shall meet select fill gradation specifications for the #200 sieve.

ASTM C 33 (Limits for Fine Aggregates)

Sieve Size	Passing (%) Washed Sieve
$\frac{3}{8}$ in (9.5 mm)	100
#4 (4.75 mm)	95 - 100
#8 (2.36 mm)	80 - 100
#16 (1.18mm)	50 - 85
#30 (600 μ m)	25 - 60
#50 (300 μ m)	5 - 30
#100 (150 μ m)	0 - 10
#200 (75 μ m)	0 - 5

11.1.12.2 Manufactured Select Fill

The Commissioner may approve manufactured select fill. Rock or other product used to produce manufactured select fill shall have a loss of abrasion of not more than 50% using AASHTO Method T-96, and when tested for soundness using AASHTO Method T104 does not have a loss of more than 15% at the end of 5 cycles. The suggested minimum permeability of manufactured fill is 15 feet per day; however, the minimum average permeability must be at least 10 feet per day. The Commissioner may require additional testing and documentation on manufactured fill with an average permeability between 10 and 15 feet per day. Suppliers of manufactured fill shall make application for approval to the Commissioner. Documentation shall be submitted on the manufactured fill operation and production process. Fill specifications/test results (e.g., loss of abrasion, soundness, gradation, permeability) and a narrative of the supplier's quality control/quality assurance (QC/QA) program shall be included for all active production sites. Approved manufactured fill producers shall provide an annual registration to the Commissioner by July 1st of each year, which includes updated test results and QC/QA narratives. Manufactured fill approval applications and annual registrations shall include a signed statement attesting that the test results submitted to the Commissioner are typical of routine QC/QA test results.

11.1.12.3 Preparing Leaching Area: Select Fill Placement

The licensed installer is responsible for preparing the leaching area with acceptable select fill. Topsoil in the leaching system area shall be removed and the subsoil scarified prior to select fill placement, unless otherwise directed by the design P.E. The installer shall take the necessary steps to protect the underlying receiving soil from over compaction/damage. The installer is responsible for properly compacting select fill to facilitate construction and to prevent settling. Select fill shall extend a minimum of 5 feet laterally beyond the outer perimeter of the leaching system; on sloped lots only, select fill shall be reduced to 2 feet on the sides and up gradient of the leaching system. Percolation testing of the select fill is required whenever the leaching system is installed entirely in select fill.

11.1.13 Grading and Cover

The ground surface over the entire SSDS shall be graded and maintained to lead surface water away from the system. SSDSs shall be protected from siltation and erosion during and after construction. Leaching systems (including distribution pipes on top of system) shall be covered with a minimum of 6 inches of acceptable soil and finished in a condition that will prevent erosion. Proprietary leaching systems shall be covered with additional soil in conformance with the manufacturer's installation instructions. Licensed installers shall properly cover leaching systems within 2 working days following the DOH's final inspection and approval, and prior to heavy precipitation events.

11.2 Leaching Trenches

Leaching trench rows shall be installed level and follow ground contours. Leaching trenches shall be filled with approved aggregate. Stone aggregate shall meet the #4 or #6 stone aggregate gradation in section 11.1.11. Perforated effluent distribution pipe of acceptable material (Table 2-A) with perforations in a downward direction shall be laid the entire length of the trench near the top layer of aggregate with a minimum 6 inches (for 48 inch wide trenches) or 12 inches (for 36 inch or less wide trenches) of aggregate under the pipe. Perforated distribution pipes shall be laid level or on a grade not exceeding 3 inches per 100 feet. Additional ELA credit of 0.6 SF/LF shall be given to the leaching trench credits below if the distribution pipe is installed on top of the leaching trench aggregate. Perforated distribution pipe placed on top of approved aggregate shall be 4 inch heavy duty pipe (Table 2-A). Filter fabric must cover the aggregate and distribution pipe, and aggregate must be cradled around the bottom portion of the pipe to prevent the filter fabric from obstructing the perforated pipe openings.

For the purposes of sections 11.6 and 12, the ELA of leaching trenches and corresponding minimum C to C spacing between trench rows shall be as follows:

Trench Depth (inches)	Trench Width (inches)	Effective Leaching Area (SF/LF)	Center to Center Spacing (feet)
18	18	2.1	7
18	24	2.4	7

Trench Depth (inches)	Trench Width (inches)	Effective Leaching Area (SF/LF)	Center to Center Spacing (feet)
18	30	2.7	7
18	36	3.0	7
12	48	3.0	8

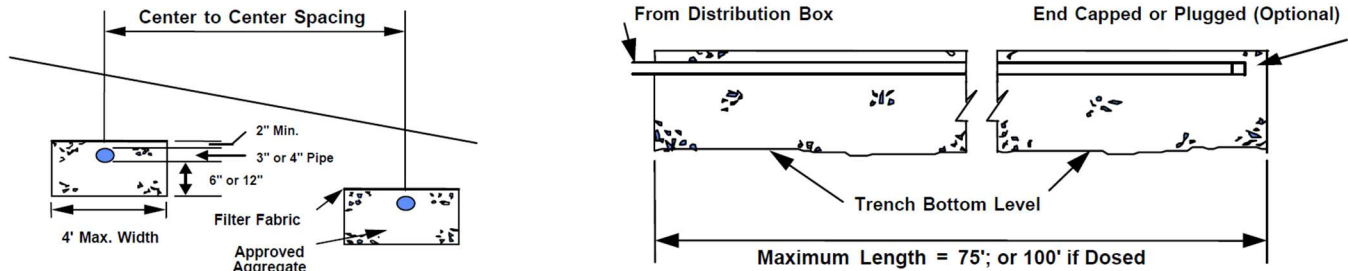


Figure 13. Leaching Trenches

11.3 Leaching Pits

Leaching pits shall be hollow structures with perforated walls and solid covers. The side walls shall be surrounded by 12 to 24 inches of approved aggregate, and the hollow structure shall be 5 to 10 feet in diameter. Stone aggregate shall meet the #4 stone aggregate gradation in section 11.1.11. Covers shall be equipped with a cleanout manhole. C to C spacing of leaching pits shall be at least 4 times the diameter of the hollow structure. No more than 2 leaching pits shall be connected in series. The bottom of leaching pits shall not be more than 8 feet below grade. Leaching pits shall not be used where the percolation rate is slower than 20 minutes per inch.

For the purposes of sections 11.6 and 12, the ELA of leaching pits shall consist of only the side area of the usable aggregate-filled excavation. The maximum utilization of a leaching pit shall not be higher than the septic tank outlet elevation or the high-level overflow elevation of the serial distribution box.

ELA = Excavation Diameter X π X Pit Depth (Note: π equals approximately 3.14)

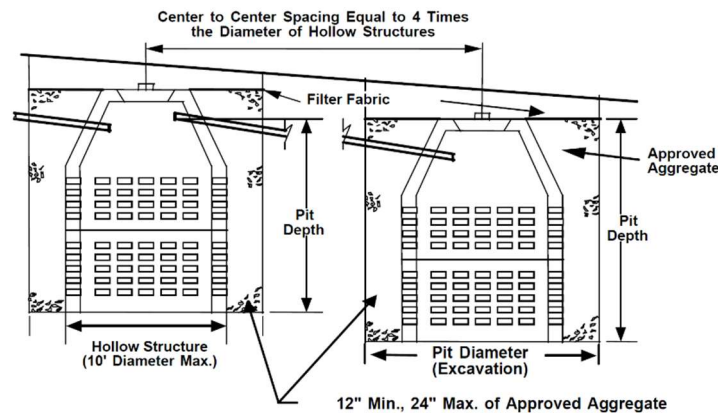


Figure 14. Leaching Pits

11.4 Leaching Galleries

Leaching gallery rows shall be installed level and follow ground contours. Leaching galleries shall be hollow structures with perforated or open joint sides and solid covers. Leaching galleries shall provide a minimum 40 inches of open bottom width. The sidewalls shall have a minimum depth of 12 inches and a maximum depth of 4 feet, including up to 6 inches of approved aggregate above the top of the structure. If approved aggregate is

placed on top of the structure for additional credit, then perforated distribution pipe shall be located above the top of the gallery if feasible. Twelve inches of approved aggregate shall be placed on the sides of concrete galleries and ends of the gallery rows. Stone aggregate backfill for concrete galleries shall meet the #4 stone aggregate gradation in section 11.1.11. The width of the trench excavation shall not be less than 6 feet, and the width of the hollow structure(s) shall be not less than 4 feet. The total length of excavated gallery row shall be utilized to calculate ELA. 4 inch heavy duty perforated distribution pipe (Table 2-A) may be installed on top of the gallery aggregate to receive an additional ELA credit of 0.6 SF/LF for 12 inch-high galleries, and 0.8 SF/LF for all other galleries. Filter fabric must cover the aggregate and distribution pipe, and aggregate must be cradled around the bottom portion of the pipe to prevent the filter fabric from obstructing the perforated pipe openings.

For the purposes of sections 11.6 and 12, the ELA of leaching galleries rows and corresponding minimum C to C spacing between gallery rows shall be as follows:

Gallery Height (inches)	Effective Leaching Area (SF/LF)	Center to Center Spacing (feet)
48	9.2	12
36	8.0	12
30	7.4	12
27	7.1	12
24	6.8	12
18	6.2	12
12	5.9	12

Single plastic chambers (e.g., Infiltrator ISI 3050, Cultec Recharger 330XL HD) or multiple plastic chambers (e.g., Infiltrator Quick4 Plus Standard) may be utilized in a gallery configuration (Figure 16) if the minimum open bottom

width of 40 inches is provided, and the proprietary leaching system company authorizes such installation practice. Infiltrator Quick4 Plus Standard) may be utilized in a gallery configuration (Figure 15) if the minimum open bottom width of 40 inches is provided, and the proprietary leaching system company authorizes such installation practice. Stone aggregate backfill for plastic chambers shall meet the #4 or #6 stone aggregate gradation in section 11.1.11.

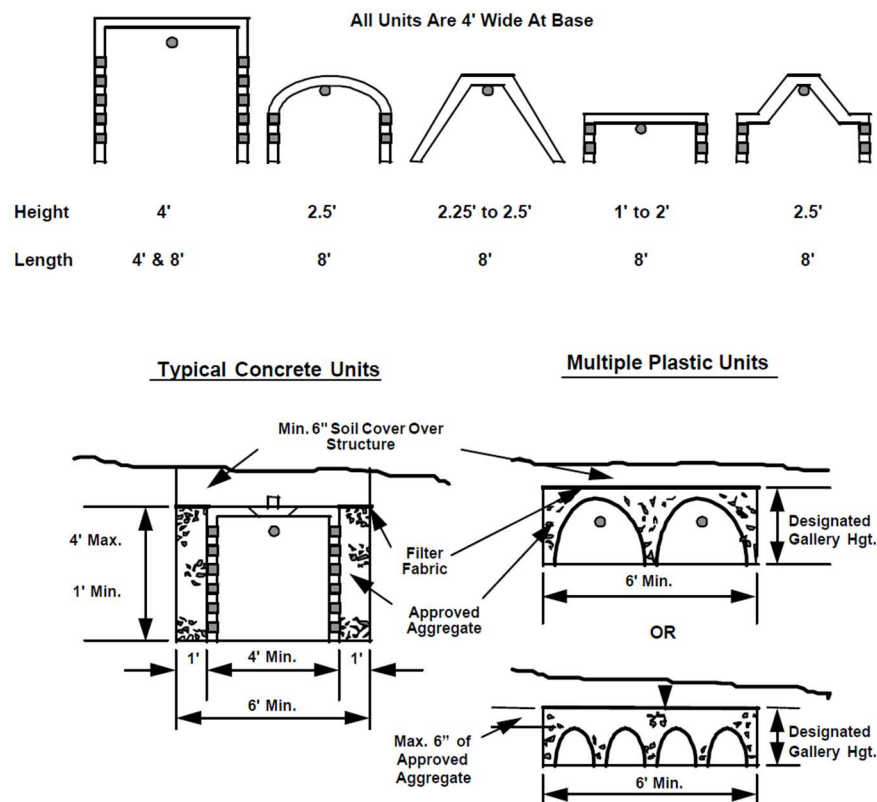


Figure 15. Typical Leaching Gallery Structures

11.5 Proprietary Leaching Systems

Installation procedures, including the minimum depth of cover, shall be conducted per manufacturer's specifications. It is the responsibility of proprietary leaching system companies to ensure that installers are properly trained in installation protocols and procedures. Proprietary leaching system rows shall be

installed level and follow ground contours. Proprietary leaching systems that require placement of soil at the infiltrative interface shall be backfilled with select fill unless otherwise noted. Several proprietary leaching products require use of ASTM C 33 sand or washed sand meeting Connecticut Department of Transportation (DOT) Form 817 Table M.01.03-01 for fine aggregate. ASTM C 33 sand and DOT washed sand contains no medium and large ($\frac{3}{8}$ " to 3") gravel and limited (less than 5%) small (#4 sieve to $\frac{3}{8}$ ") gravel. Sand specified for the infiltrative interface shall meet select fill gradation specifications for the #100 and #200 sieves. Stone aggregate utilized in proprietary leaching systems shall meet stone aggregate requirements, and the #4 or #6 stone aggregate gradation in section 11.1.11. For sections 11.6 and 12, the ELA of the products listed below and corresponding minimum C to C spacing between product rows are listed in the leaching product tables.

11.5.1 Plastic Leaching Chambers

Plastic Leaching Chambers Backfilled with Select Fill or Approved Aggregate: A 0.4 SF/LF ELA reduction shall be assessed if the chambers are not backfilled with select fill:

Product Name	Dimensions (W x H)	Effective Leaching Area (SF/LF)	Center to Center Spacing (feet)
Infiltrator - Equalizer 24	15" x 11"	2.3	7
Infiltrator - Equalizer 36	22" x 13.5"	2.7	7

Plastic Leaching Chambers Backfilled with Approved Aggregate:

Product Name	Dimensions (W x H)	Effective Leaching Area (SF/LF)	Center to Center Spacing (feet)
Cultec - Contactor EZ-24	16" x 12"	1.9	7
Cultec - Contactor EZ-24 (PDS)	16" x 12"	2.5	7
Cultec - Contactor 100	36" x 12.5"	3.7	7
Cultec - Contactor 100 (PDS)	36" x 12.5"	4.3	7
Cultec - Recharger 180	36" x 20.5"	4.4	7
Cultec - Recharger 180 (PDS)	36" x 20.5"	5.1	9
Cultec - Recharger 280	46" x 26.5"	6.5	10
Cultec - Recharger 280 (PDS)	46" x 26.5"	7.1	10
Cultec - Recharger 330XLHD	52" x 30"	5.6	11
Infiltrator Quick4 Equalizer 24	16" x 11"	2.0	7
Infiltrator Quick4 Equalizer 36	22" x 12"	2.6	7
Infiltrator Quick4 Standard	34" x 12"	3.6	7
Infiltrator Quick4 High Capacity	34" x 16"	4.1	7
Infiltrator Arc 36	34.5" x 13"	3.7	7
Infiltrator Arc 36HC	34.5" x 16"	4.1	7
Infiltrator Quick4 Plus Equalizer 36 Low Profile	22" x 8"	2.4	7
Infiltrator Quick4 Plus Standard Low Profile	34" x 8"	3.4	7
Infiltrator Quick4 Plus Standard	34" x 12"	3.8	7
Infiltrator Quick4 Plus High Capacity	34" x 14"	3.9	7
Infiltrator Quick5 Standard	34" x 12"	3.7	7
Infiltrator Quick5 Equalizer 36	22" x 12"	2.7	7
Infiltrator Arc 24	22" x 12"	2.6	7
Infiltrator Arc 36 LP	34" x 8"	3.4	7

Corrugated Leaching Systems Lined/Covered with Filter Fabric: Filter fabric lined products shall be backfilled with select fill. Lined products backfilled with non-select fill may be approved by the Commissioner at reduced ELA credits upon application by the proprietary leaching system company.

Product Name	Dimensions (Diameter / W x H)	Effective Leaching Area (SF/LF)	Center to Center Spacing (feet)
GEO-FLOW	12" Diameter	2.3	7
Presby Env. - ENVIRO-SEPTIC	12" Diameter	2.3	7
Presby Env. - SIMPLE-SEPTIC	12" Diameter	1.5	7
ADS - SB2	10" Diameter	0.9	7
Cultec - Contactor EZ-24	16" x 12"	1.9	7
Cultec - Contactor EZ-24 (PDS)	16" x 12"	2.5	7

Product Name	Dimensions (Diameter / W x H)	Effective Leaching Area (SF/LF)	Center to Center Spacing (feet)
Cultec - Contactor 100	36" x 12.5"	3.7	7
Cultec - Contactor 100 (PDS)	36" x 12.5"	4.3	7
Cultec - Recharger 180	36" x 20.5"	4.4	7
Cultec - Recharger 180 (PDS)	36" x 20.5"	5.1	9
Cultec - Recharger 280	46" x 26.5"	6.5	10
Cultec - Recharger 280 (PDS)	46" x 26.5"	7.1	10
Cultec - Recharger 330XLHD	52" x 30"	5.6	11
Infiltrator Quick4 Equalizer 24	16" x 11"	2.0	7
Infiltrator Quick4 Equalizer 36	22" x 12"	2.4	7
Infiltrator Quick4 Standard	34" x 12"	3.3	7
Infiltrator Quick4 High Capacity	34" x 16"	3.7	7
Infiltrator Arc 36	34.5" x 13"	3.9	7
Infiltrator Arc 36HC	34.5" x 16"	4.5	7
Infiltrator Quick4 Plus Equalizer 36 Low Profile	22" x 8"	2.3	7
Infiltrator Quick4 Plus Standard Low Profile	34" x 8"	3.4	7
Infiltrator Quick4 Plus Standard	34" x 12"	3.9	7
Infiltrator Quick4 Plus High Capacity	34" x 14"	4.1	7
Infiltrator Quick5 Standard	34" x 12"	3.0	7
Infiltrator Quick5 Equalizer 36	22" x 12"	2.3	7
Infiltrator Arc 24	22" x 12"	2.4	7
Infiltrator Arc 36 LP	34" x 8"	3.3	7

11.5.2 GreenLeach Filter

GreenLeach Filter (GLF) units shall be bedded on the bottom and sides with sand fill meeting both the manufacturer's specifications and select fill specifications. The standard GLF units include a filter fabric/cardboard interface. An alternative non-filter fabric option (GLF-NF) that includes a cardboard interface without a fabric lining has been approved for all GLF products with the same ELA ratings.

Product Name	Dimensions (W x H)	Effective Leaching Area (SF/LF)	Center to Center Spacing (feet)
GLF 12.62	62" x 12"	7.9	12
GLF 12-72	72" x 12"	10.1	14
GLF 15.62	62" x 15"	9.4	12
GLF 15-72	72" x 15"	12.1	14
GLF 18.62	62" x 18"	11.0	14
GLF 18-72	72" x 18"	14.1	14
GLF 21.62	62" x 21"	12.5	14
GLF 21-72	72" x 21"	16.1	14
GLF 24.62	62" x 24"	14.0	14
GLF 24-72	72" x 24"	18.2	14
GLF 27.62	62" x 27"	15.5	14
GLF 27-72	72" x 27"	20.2	14
GLF 30.62	62" x 30"	17.0	14
GLF 30-72	72" x 30"	22.2	14
GLF 33.62	62" x 33"	18.5	14
GLF 33-72	72" x 33"	24.2	14
GLF 36.62	62" x 36"	20.0	14
GLF 36-72	72" x 36"	26.2	14
GLF 12.37	37" x 12"	4.7	9
GLF 15.37	37" x 15"	5.6	9
GLF 18.37	37" x 18"	6.5	9
GLF 21.37	37" x 21"	7.3	9
GLF 24.37	37" x 24"	8.2	9
GLF 27.37	37" x 27"	9.1	9
GLF 30.37	37" x 30"	9.9	9

Product Name	Dimensions (W x H)	Effective Leaching Area (SF/LF)	Center to Center Spacing (feet)
GLF 33.37	37" x 33"	10.8	12
GLF 36.37	37" x 36"	11.7	12

11.5.3 Cur-Tech Systems

Cur-Tech units shall be backfilled on the sides with sand fill meeting both the manufacturer's specifications and select fill specifications.

Product Name	Dimensions (W x H)	Effective Leaching Area (SF/LF)	Center to Center Spacing (feet)
CTL-12	72" x 14"	8.3	12
CTL-18	72" x 20"	10.7	14
CTL-24	72" x 26"	13.0	14
CTL-48	72" x 50"	21.9	14

11.5.4 Ruck A Fins

Ruck A Fins units shall be bedded on the bottom and sides with sand fill meeting both the manufacturer's specifications and select fill specifications.

Product Name	Dimensions (W x H)	Effective Leaching Area (SF/LF)	Center to Center Spacing (feet)
Ruck A Fins - R1032C	32" x 7"	7.0	9

11.5.5 FORM CELL Living Filter

Living Filter units shall be bedded on the bottom and sides with sand fill meeting both the manufacturer's specifications and select fill specifications.

Product Name	Dimensions (W x H)	Effective Leaching Area (SF/LF)	Center to Center Spacing (feet)
Living Filter- LF1210	29" x 18"	3.9	7
Living Filter- LF1810	29" x 24"	5.5	9
Living Filter- LF2410	29" x 30"	7.0	9
Living Filter- LF3010	29" x 36"	8.6	9
Living Filter- LF3610	29" x 42"	10.1	12
Living Filter- LF1224	60" x 18"	7.4	11
Living Filter- LF1826	64" x 24"	11.0	12
Living Filter- LF2426	64" x 30"	14.2	14
Living Filter- LF3026	64" x 36"	17.3	14
Living Filter- LF3626	64" x 42"	20.4	14

11.5.6 Eljen

Eljen products shall be bedded on the bottom and sides with sand fill meeting both the manufacturer's specifications and select fill specifications.

Product Name	Dimensions (W x H)	Effective Leaching Area (SF/LF)	Center to Center Spacing (feet)
Eljen B43	36" x 7"	4.7	7
Mantis 536-8	36" x 18"	11.0	12
Product Name	Dimensions (W x H)	Effective Leaching Area (SF/LF)	Center to Center Spacing (feet)
Mantis 536-8 LowPro	36" x 12"	6.5	9
Mantis Double-Wide 58	72" x 12"	11.6	14
Mantis Double-Wide 100	72" x 18"	20.0	14
Yard Filter 33	40" x 10"	6.7	12

Yard Filter 50	36" x 17.5"	10.0	9
Yard Filter 53	72" x 10"	10.7	14
Yard Filter 95	72" x 17.5"	19.0	14

11.5.7 Geomatrix

In accordance with the stipulations of Geomatrix Systems, LLC, unless otherwise authorized by Geomatrix Systems, LLC, all GeoMat Edge and GeoU leaching systems shall be installed in conjunction with a Soil Air System approved for use by Geomatrix Systems, LLC, and S-Box (SB1 series) leaching systems shall be configured for use with a Soil Air System that entails installing an air supply line for possible future use. See section 11.7 for additional information on use of the Soil Air System.

Product Name	Dimensions (W x H)	Effective Leaching Area (SF/LF)	Center to Center Spacing (Feet)
GeoMat 1200	12" x 1"	1.0	7
GeoMat 3900	39" x 1"	3.0	8
GeoMat 7800	78" x 1"	5.9	13
LowPro WE 1200	72" x 1"	5.2	12
LowPro WE 3900	72" x 1"	5.6	12
GeoMat Edge ST 600	72" x 6"	14.0	14
GeoMat Edge ST 1200	72" x 14"	27.2	14
GeoMat Edge WE 1200	72" x 13"	27.2	14
GST 6206	62" x 6"	5.9	12
GST 6212	62" x 12"	10.0	12
GST 6218	62" x 18"	14.0	13
GST 6224	62" x 24"	18.1	13
GST 6230	62" x 30"	22.1	13
GST 6236	62" x 36"	26.2	13
GST 3706	37" x 6"	3.6	8
GST 3712	37" x 12"	5.9	10
GST 3718	37" x 18"	8.2	10
GST 3724	37" x 24"	10.5	12
GST 3730	37" x 30"	12.9	12
GST 3736	37" x 36"	15.2	12
GeoU636	36" x 6.5"	8.0	9
GeoU672	72" x 6.5"	15.5	14
GeoU1236	36" x 12.5"	14.8	12
GeoU1272	72" x 12.5"	28.8	14
GeoU1836	36" x 18.5"	21.7	12
GeoU1846	46" x 18.5"	27.4	12
GeoU1851	51" x 18.5"	29.9 (max. allowed)	13
GeoU3921	21" x 39"	27.4	12
GeoU3926	26" x 39"	29.9 (max. allowed)	12
SB1-3.5-36	36" x 3.5"	4.4	7
SB1-7-36	36" x 7"	8.2	9
SB1-13-36	36" x 13"	14.7	13
SB1-26-36	36" x 26"	28.7	13
SB1-3.5-72	72" x 3.5"	8.5	12
SB1-7-72	72" x 7"	15.9	14
SB1-13-72	72" x 13"	28.5	14

Product Name	Dimensions (W x H)	Effective Leaching Area (SF/LF)	Center to Center Spacing (Feet)
GCS848	48" x 8"	6.2	10
GCS872	72" x 8"	9.8	12
GCS1248	48" x 12"	10.8	12
GCS1272	72" x 12"	17.1	14

GCS1848	48" x 18"	17.6	12
GCS1872	72" x 18"	28.2	14

11.5.8 Proprietary Pressure-Dosed Dispersal Systems

The Commissioner may approve proprietary pressure-dosed dispersal (PPD) systems, and system sizing shall be correlated to an equivalent area needed for a conventional 3 foot wide leaching trench system. ELA does not apply to the dispersal component of a PPD system. PPD ELA criteria, leaching system ratings and sizing requirements are included in section 10. New SSDS plans specifying a PPD system shall identify an area that can accommodate a conventional 3-foot wide leaching trench system including any fill and extensions necessary to construct the system. PPD systems are not required to be installed within the designated conventional leaching trench system area.

Companies requesting approval of their PPD system shall submit detailed specifications and installation requirements for their package systems to the Commissioner, which include dosing and dispersal system components, as well as operation and monitoring information. Dispersal system sizing requirements and tubing/piping spacing of laterals shall be approved by the Commissioner based on a review of supporting documentation from the company.

Installation procedures, including the minimum depth of cover, shall be per manufacturer's specifications. It is the responsibility of the PPD system company to ensure that installers are properly trained in installation protocols and procedures. Operation and maintenance (O and M) requirements for PPD systems shall be specified by the company and shall be listed on the permit to discharge. Property owners that receive approval for a PPD system shall be required to have O and M on the system by a vendor-trained and authorized individual. Service contracts for routine O and M is typically a requirement for these systems.

11.5.8.1 Perc Rite Drip Dispersal System

The Perc Rite Drip Dispersal System (Vendor: American Manufacturing Company, Inc., New England Distributor: Oakson Inc.) has 3 models (ASD-15, ASD-25, and ASD-40) that are approved for use. The ASD-15 model is typically utilized for single-family applications, and the ASD-25 model is typically used for design flows exceeding 1,000 GPD. The total linear footage of the Perc Rite Drip Dispersal System shall be at least 4 times the calculated linear footage of a standard conventional 3 foot-wide leaching trench system that would be required for the building served. The drip dispersal tubing shall have a minimum C to C spacing of 18 inches or 1.5 feet, although minor deviations to the C to C spacing is allowed for small portions of the system if warranted (e.g., drip lines around trees).

11.6 Leaching System Product Approvals, ELA Ratings, and Center to Center Spacing

Approved leaching systems are assigned an ELA rating in square feet per linear foot (SF/LF) except for leaching pits (section 11.3) and the dispersal system component of PPD systems (section 11.5.8). Approved leaching systems with assigned ELA ratings are listed in section 11.5, or in a leaching system approval issued by the Commissioner. Proprietary leaching system companies shall submit new product approval requests to the Commissioner along with product specifications, drawings, cross-sections, and dated installation instructions. The Commissioner may require third party/independent test data in conjunction with proprietary leaching system reviews/approvals that are deemed substantially different than those currently approved.

Approved leaching systems (except for the dispersal system component of PPD systems) are assigned an ELA rating that is calculated based on the amount and type of leaching system interface that the biologically active layer (bio-mat) forms upon the routine application of septic tank effluent. Interface factors for various leaching system interfaces are as follows:

Open:	2.0
Filter Fabric (No Stone):	1.5 ^a
Stone:	1.0

Filter Fabric and Stone: 0.75

- a. Factor reduced by % obstructed.

For the ELA ratings, the factors noted for stone are used also for other approved aggregate, and the filter fabric interface factors also apply to cardboard and cardboard/filter fabric interfaces. 3 types of leaching system interfaces are credited sidewall, bottom and internal.

1. Sidewall Interfaces: discharge wastewater that does not pass through the product footprint area, which is the horizontal area within a rectangular boundary around the outermost perimeter of the leaching system interface.
2. Bottom Interfaces: discharge wastewater from the bottom of the product. No credit is given for bottom interfaces that include cardboard.
3. Internal Interfaces: non-bottom leaching surfaces that discharge wastewater from within and through the product footprint area.

Horizontal measurements are used for bottom interfaces, except for corrugated pipes. Vertical measurements are utilized for sidewall and internal leaching interfaces, except for corrugated pipes. Corrugated pipes measurements taken along the perimeter of the pipe. Sidewall and internal interfaces are credited up to the leaching system's pipe invert unless otherwise established by the Commissioner. No ELA rating shall exceed 29.9 SF/LF.

The Commissioner may establish credit limitations that are applicable to competing bio-mats (overlapping bio-mats of specified thickness), and internal interfaces. Proprietary leaching systems approved after January 1, 2015 shall receive no credit for competing bio-mats less than ½ inch apart and 50% credit for competing bio-mats ½ to 2 inches apart, and internal interfaces less than 4 inches apart shall not be credited unless the proprietary leaching system company satisfactorily demonstrates there is sufficient bottom sand area available to transmit the partly treated septic tank effluent while maintaining low soil moisture content in the sand column, and such assessments shall discount the sand area within 1 inch of internal interfaces. The Commissioner may require a re-evaluation of ELA credits for currently approved leaching systems relative to the credit given for competing bio-mats and internal interfaces following the adoption of criterion for crediting limitations. As part of any re-evaluation of ELA credits, the Commissioner may require proprietary leaching system companies that have products approved prior to January 1, 2015, to submit product information (e.g., specifications, drawings, cross-sections) for the systems to remain approved.

Leaching system C to C minimum spacing, except for leaching pits (section 11.3) and the dispersal system utilized in PPD systems (section 11.5.8), is determined based on the following:

- ELA rating of 5.0 SF/LF or less: 7 feet minimum and at least 4 feet leaching row edge to edge.
- ELA rating from 5.1 to 10.0 SF/LF: 9 feet minimum and at least 6 feet leaching row edge to edge.
- ELA rating exceeding 10.0 SF/LF: 12 feet minimum and at least 8 feet leaching row edge to edge.

The Commissioner may approve reduced C to C spacing reductions at the request of a product manufacturer for shallow leaching systems in LPD applications. No consideration for reduced spacing shall be given to leaching systems receiving internal interface credits until criterion for crediting limitations for internal interfaces are established by the Commissioner. Approvals for reduced leaching system spacing shall provide a minimum of 6 inches leaching row edge to edge for each 1 SF, or part thereof, per linear foot ELA credit. Reduced spacing will only be considered if it is satisfactorily demonstrated that a licensed installer can reasonably install the leaching product without compromising the installation of the leaching system.

11.7 Leaching System Enhancement and Rejuvenation

The patented Soil Air System provided by Geomatrix, LLC may be utilized on new SSDSs as part of the plan proposed for approval and permitting, or on existing SSDSs that are not at risk of hydraulically overloading the receiving soil and provide the required minimum separation distance above ledge rock and maximum

groundwater. Utilization of the Soil Air System on an existing SSDS requires a permit from the DOH as a repair to an existing SSDS. A site investigation shall be conducted by the DOH to gather soil test data if there is no prior soil testing data available.

Existing SSDSs that are determined to be candidates for the Soil Air System shall be evaluated to determine whether the system complies with the requirements of the PHC and Technical Standards. A repair plan shall be submitted identifying the location of the existing system and a code-complying area. Sites that cannot support a code-complying area shall have a potential repair area identified in the repair plan. Large SSDSs shall require engineered plans that shall be submitted to the Commissioner for approval as required by PHC section 19-13-B103d(d). The DOH may require a P.E. plan for small (< 2,000 GPD) SSDSs in areas of special concern in accordance with PHC section 19-13-B103d(g) and 19-13-B103d(h).

The Soil Air System shall not be utilized on cesspools, or excessively undersized leaching systems unless determined that it is not feasible to expand the leaching system. Leaching systems are excessively undersized if they provide less than 50% of the required ELA. The DOH may require further upgrades to existing SSDSs in conjunction with implementation of the Soil Air System. Upgrades may include leaching system expansion or the installation of additional tanks (septic, grease interceptor). Soil Air Systems may be installed with the placement of a plastic membrane over the leaching system. Placement of such a membrane over a proprietary leaching system requires authorization from the proprietary leaching system company.

Soil Air Systems shall be periodically evaluated and monitored by the manufacturer to verify satisfactory system operation. The permit to discharge shall require written notification from the owner or responsible party to the DOH prior to the removal or termination of use of the Soil Air System. A standard tee baffle may only be utilized in place of an effluent filter on the septic tank outlet if approved by the DOH based on the joint proposal by Geomatrix, LLC and the system designer. The effluent filter shall be re-installed if the Soil Air System is removed.

11.8 Leaching System Clogging Break-Up

EarthBuster and Terra-lift are separate patented processes each utilizing air injection into the soil as a method intended to help rejuvenate an existing leaching system's soil interface. These processes may be used on leaching systems that provide the required minimum separation distance above ledge rock and maximum groundwater, and that have historically operated satisfactorily but have experienced declining capacity due to infiltrative surface clogging. The depth of air injection shall not exceed the depth of the leaching system bottom and locations shall be no closer than 2 feet horizontally to the leaching system sidewall. Use of either process requires a permit as either a new or repaired SSDS from the DOH. A site investigation shall be conducted by the DOH to gather soil test data if there is no prior soil testing data available.

Existing SSDSs that are determined to be candidates for either process shall be evaluated to determine to determine whether the system complies with the requirements of the PHC and Technical Standards. A repair plan shall be prepared by an installer or PE identifying the location of the existing system and a code-complying area. Sites that cannot support a code-complying area shall have a potential repair area identified in the repair plan. Large SSDSs shall require engineered plans that shall be submitted to the Commissioner for approval as required by PHC section 19-13-B103d(d). The DOH may require a P.E. plan for small (< 2,000 GPD) SSDSs in areas of special concern in accordance with PHC section 19-13-B103d(g) and 19-13-B103d(h).

EarthBuster and Terra-lift shall not be utilized on cesspools, or excessively undersized leaching systems unless it is determined by the DOH that it is not feasible to expand the leaching system. Leaching systems are excessively undersized if they provide less than 50% of the required ELA. The DOH may require further upgrade of existing SSDSs in conjunction with implementation of either process. Upgrades may include leaching system expansion or the installation of additional tanks (septic, grease interceptor).

12. Leaching System Sizing

12.1 Residential Buildings

The required effective leaching area (ELA) for a SSDS serving a residential building(s) shall be based on the number of bedrooms and the percolation rate in accordance with Table 6 and the following:

- (a) A separate SSDS for a 1 bedroom residential outbuilding shall have a required ELA equal to 50% of that required for a 2 bedroom building.
- (b) When sizing a single-family residential building with an attached or internal accessory apartment, the required ELA for the main house shall be based on the single-family criteria and the required ELA for such accessory apartment shall be based on the multi-family criteria in Table 6.
- (c) A central SSDS serving a single-family residential building and a residential outbuilding, the required ELA for each bedroom in a residential outbuilding shall be based on the multi-family ELA criteria.
- (d) The minimum ELA for a multi-family residential building shall be based on a minimum of 4 bedrooms.
- (e) Small community sewerage systems shall apply the multi-family ELA criteria for each bedroom above 3.
- (f) Single family and multi-family criteria shall not be applied until after the third bedroom for any individual SSDS.

Table 6. Required Effective Leaching Area Criteria for Residential Buildings

Percolation Rate (Minutes/Inch)	Required Effective Leaching Area (ELA) (Square Feet)			
	2-Bedroom Bldg.	3-Bedroom Bldg.	For Each Bedroom Above 3	
			Single-Family	Multi-Family
Less than 10.1	375	495	82.5	137.5
10.1-20.0	500	675	112.5	187.5
20.1-30.0	565	750	125	208.5
30.1-45.0	675	900	150	250
45.1-60.0	745	990	165	275

12.2 Restaurants, Residential Institutions, and Nonresidential Buildings with Problematic Sewage

The required ELA for a SSDS serving a restaurant, bakery, food establishment, residential institution, laundromat, beauty salon, or other nonresidential building with problematic sewage flows shall be determined by dividing the design flow by the application rate listed in Table 7. See section 7 for design flow and problematic sewage information.

Table 7. Application Rates for Problematic Sewage Flows

Percolation Rate (Minutes/Inch)	Application Rate (GPD per Square Foot of ELA)
Less than 10.1	0.8
10.1-20.0	0.7
20.1-30.0	0.6
30.1-45.0	0.5
45.1-60.0	0.4

12.3 Nonresidential Buildings with Nonproblematic Sewage

The required ELA for a SSDS for a nonresidential building, other than those covered by section 12.2 and Table 7, with nonproblematic sewage flows shall be sized on the design flow and application rates listed in Table 8. See section 7 for design flow and problematic sewage information.

Table 8. Application Rates for Non-Problematic Sewage Flows

Percolation Rate (Minutes/Inch)	Application Rate (GPD per Square Foot of ELA)
Less than 10.1	1.5
10.1-20.0	1.2
20.1-30.0	0.9
30.1-45.0	0.7
45.1-60.0	0.6

To calculate required ELA for nonresidential buildings (using Tables 7 and 8): $\frac{\text{Design Flow}}{\text{Application Rate}}$

13. Minimum Leaching System Spread (MLSS)

13.1 Overview

Section 13.1 includes requirements for leaching system compliance with MLSS for new and repair SSDSs, and the necessity for new SSDSs to have sufficient naturally occurring soil to disperse effluent from the leaching system. Code-complying areas identified pursuant to PHC section 19-13-B100a are also required to be laid out in an area with sufficient naturally occurring soil to accommodate MLSS compliant leaching systems. Receiving soil utilized for a leaching system repair may consider fill material if sufficient naturally occurring soil is not available.

Separate leaching systems that rely on the same receiving soil for the dispersal of effluent shall be evaluated collectively as a single leaching system. This applies to leaching systems on sloped lots less than 50 feet apart within the same hydraulic window and leaching systems less than 25 feet apart on radial flow lots. A single leaching system row shall contain leaching units with similar ELA ratings (within 10%) or shall be analyzed to ensure no portion of the receiving soil is overloaded, unless MLSS is not applicable.

13.2 Definitions

- A. "Hydraulic gradient" means the % slope of the naturally occurring grade, or when demonstrated, the % slope of the restrictive layer. The hydraulic gradient on a lot with radial flow over a flat groundwater table shall be confirmed to be level (0 %) by evaluating groundwater elevations in the leaching system area and surrounding soil. The hydraulic gradient on a lot that utilizes the slope of the naturally occurring soil as the gradient shall evaluate the naturally occurring grade within and at least 25 feet down-gradient of the leaching system.
- B. "Leaching system spread" means the leaching system length of effluent application to the receiving soil. The leaching system spread for a leaching system that disperses effluent via radial flow over a flat groundwater table shall be measured around the perimeter of the leaching system. The leaching system spread for a leaching system that disperses effluent along a hydraulic gradient shall be measured perpendicularly to the hydraulic gradient and shall consider converging and diverging contours at least 25 feet down-gradient of the leaching system.
- C. "Receiving soil" (per section 4) means the soil in the leaching system area and surrounding soil that is available to disperse effluent. Surrounding soil for a leaching system that disperses effluent via radial flow over a flat groundwater table includes the soil within 25 feet around the perimeter of the leaching system. Surrounding soil for a leaching system that disperses effluent along a hydraulic gradient includes the soil within 50 feet down-gradient of a large (2,000 to 10,000 GPD) system, and at least 25 feet down-gradient of a small system.
- D. "Redoximorphic" means specific color patterns in soil caused by the alternating reduction, movement, and oxidation of iron and manganese indicating prolonged water saturation followed by drying of the soil and indicative of a groundwater table.
- E. "Receiving soil (RS) depth" means the average depth of receiving soil (soil in a leaching system area and surrounding soil) measured down to the restrictive layer.
- F. "Restrictive layer" means the first layer beneath the receiving soil that impedes downward movement of effluent. Restrictive layers include ledge rock, maximum groundwater, and impervious soil (percolation rate slower than 60 minutes per inch). The depth to maximum groundwater shall be determined by field verification of redoximorphic features or groundwater monitoring. Standpipe readings used for groundwater monitoring shall utilize the average of at least 5 consecutive weekly readings taken during the most restrictive 30-day period of the wet season.

13.3 Minimum Leaching System Spread (MLSS) Formula

The following formula is used to calculate the MLSS:

Hydraulic Factor (HF): is based on the hydraulic gradient and receiving soil depth.

Flow Factor (FF): is based on the design flow of the building served.

Percolation Factor (PF): is based on the percolation rate of the receiving soil.

$$\text{MLSS (Feet)} = \text{HF} \times \text{FF} \times \text{PF}$$

13.4 Receiving Soil (RS) Depth Calculations

RS Depth shall be determined based on criteria in the applicable sections 13.4.1 to 13.4.3. The general calculation for RS Depth is as follows: $\text{RS depth} = (A+B) / 2$

A = Receiving soil in the leaching system (LS) area.

B = Receiving soil surrounding the LS.

Surrounding soil is down-gradient of the LS on lots with sloped restrictive layers, and soil around the perimeter of the LS on lots with flat groundwater tables.

13.4.1 SSDS Layouts for New Lot Creations

Leaching system spreads shall equal or surpass the MLSS. The RS Depth shall only include naturally occurring soil in both the leaching system area and the surrounding soil area (e.g., down-gradient of leaching system, around perimeter of leaching system).

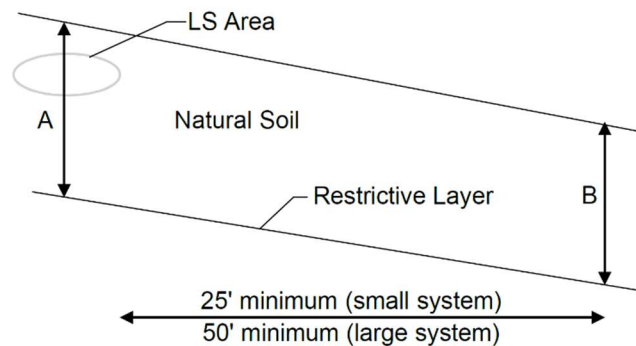


Diagram 1. Sloped Restrictive Layer


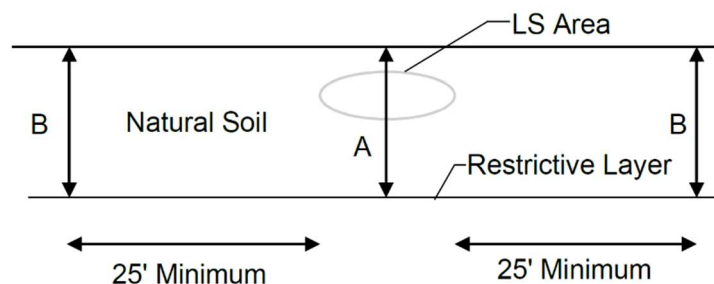


Diagram 2. Flat Groundwater Table

13.4.2 New SSDSs, MLSS Compliant Repairs, and Conceptual B100a Areas (Code-Complying and Potential Repair Areas)


Leaching system spreads shall equal or surpass the MLSS. A leaching system that is designed with the top of the system more than 12 inches below natural grade shall have receiving soil in the leaching system area measured from the top of the system to the restrictive layer (see Diagram 4).

Receiving soil may include select fill (maximum of 24 inches) measured to the top of the system from original grade in the leaching system area if all the receiving soil is on the property and there is at least 18 inches of naturally occurring receiving soil (see Diagram 3). A maximum RS depth of 60 inches is allowed when select fill is included in receiving soil measurement in leaching system area.

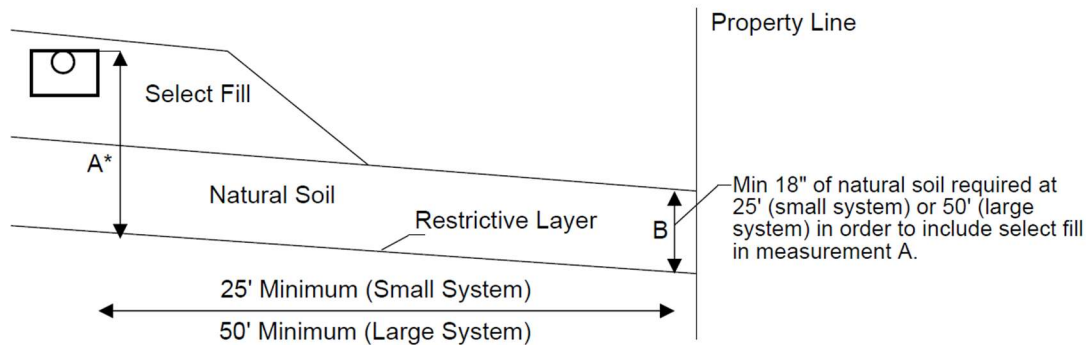

*Receiving soil in LS area may include up to 24" of select fill measured from top of system if all receiving soil is on property and there is at least 18" of natural soil throughout the receiving soil.

Diagram 3. LS in Select Fill (Sloped Restrictive Layer)

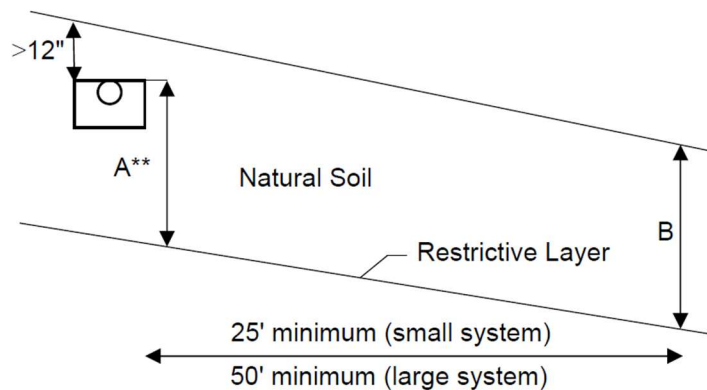

**Receiving soil in the LS area is measured from natural grade; if the top of system is more than 12" below natural grade then it is measured from the top of the system.

Diagram 4. LS in Natural Soil (Sloped Restrictive Layer)


13.4.3 MLSS Non-Compliant Repairs and PHC section 19-13-B100a MLSS Non-Compliant Potential Repair Areas

If there are less than 18 inches of naturally occurring receiving soil, or when the leaching system cannot meet the MLSS or hydraulic analysis, an exception from the DOH shall be required, and a non-compliant repair (NCR) MLSS assessment shall be conducted. The NCR MLSS considers the hydraulic capacity of existing receiving soil, both fill and naturally occurring, and additional fill included in the SSDS design. The following criteria shall be utilized in calculating the NCR MLSS:

1. Receiving soil fill shall have a percolation rate of 30 minutes per inch or faster and shall be clean material relatively free of debris and foreign objects.
2. Receiving soil in the leaching system area shall be measured from the top of the system to the restrictive layer (see Diagram 5).
3. Receiving soil on a flat groundwater table lot shall have a minimum depth of 6 inches. Receiving soil on a sloped lot shall have a minimum depth of 12 inches. (See Diagrams 5 and 6).
4. RS Depth may include both naturally occurring soil and fill and shall have a minimum depth of 18 inches and a maximum depth of 60 inches.
5. Select fill used as receiving soil shall require percolation tests after placement to confirm the basis of design. Percolation rates of different receiving soil layers shall be applied proportionately.


Leaching systems shall provide the maximum % possible of the NCR MLSS calculated based on a RS Depth—of 18.0 - 22.0 inches or based on the depth of existing receiving soil if greater. Additional fill shall be considered to reduce the calculated NCR MLSS when compliance cannot be achieved. Leaching systems that provide less than 25% of the NCR MLSS, or do not comply with items 3 and 4 above, shall require a SSDS designed by a P.E. and a study of the receiving soil's ability to absorb or disperse the permitted flow in accordance with PHC sections 19-13-B103d(h)(5) and 19-13-B103d(h)(6).

For the purposes of PHC section 19-13-B100a(c)(2) and section 7.4, the required MLSS shall be equivalent to the NCR MLSS. The permitted flow noted on the Permit to Discharge shall be based on the most limited percentage of the required ELA or NCR MLSS provided. The Permit to Discharge shall clearly state that the system is non-compliant relative to MLSS, and that an exception has been granted.

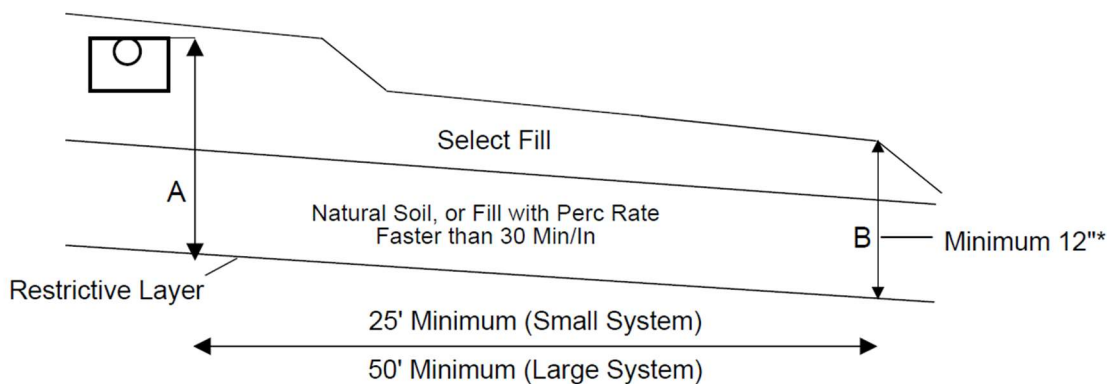

*On flat groundwater table lots, there shall be a minimum of 6" of receiving soil 25' around the perimeter of the leaching system.

Diagram 5. Select Fill, and Natural Soil or Fill, as Receiving Soil (Sloped Restrictive Layer)

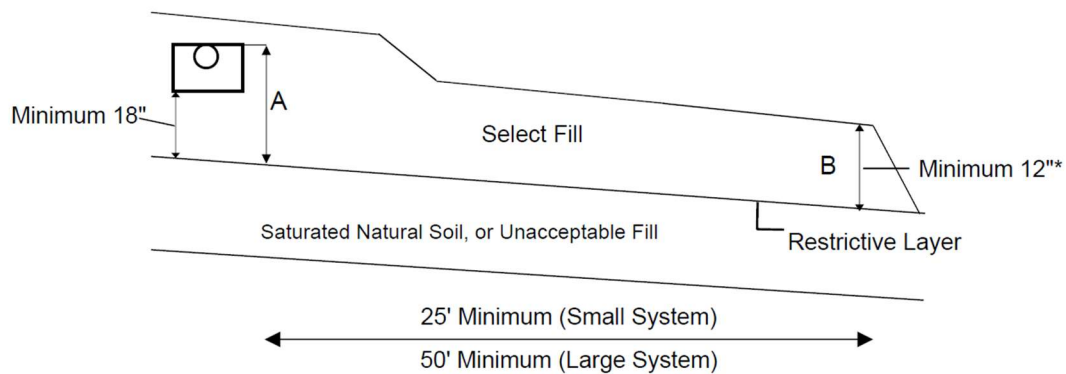

*On flat groundwater table lots, there shall be a minimum of 6" of receiving soil 25' around the perimeter of the leaching system.

Diagram 6. Select Fill Receiving Soil (Sloped Restrictive Layer)

13.5 MLSS Calculation Factor Tables

Hydraulic Factors (HF)

Receiving Soil Depth (Inches)	Hydraulic Gradient (% Slope)								
	< 1.0	1.0 - 2.0	2.1 - 3.0	3.1 - 4.0	4.1 - 6.0	6.1 - 8.0	8.1 - 10.0	10.1 - 15.0	> 15.0
	0.1 – 17.9	See Comments in Section 11.1.2.							
	18.0 – 22.0	72	62	54	48	42	34	30	26
	22.1 – 26.0	66	56	48	42	34	30	28	24
	26.1 – 30.0	56	49	42	34	30	28	26	20
	30.1 – 36.0	48	42	34	30	28	26	24	18
	36.1 – 42.0	42	36	30	28	26	24	20	16
	42.1 – 48.0	36	32	28	26	24	20	18	14
	48.1 – 60.0	30	28	24	22	20	18	16	10
	> 60.0	MLSS Need Not Be Considered.							

Flow Factors (FF)

Residential Buildings	
For the purposes of the Flow Factor (FF), the design flow for each residential building is 150 GPD per bedroom up to three. Beyond three bedrooms, the design flow is 75 GPD per bedroom for single-family residential buildings and 125 GPD per bedroom for multi-family residential buildings, residential outbuildings and internal/attached accessory apartments per section 7.1. Flow Factors (FF) shall be based on the following:	
Residential Buildings (Applies to Each SSDS):	FF
1 Bedroom = 150/300	0.5
2 Bedroom = 300/300	1.0
3 Bedroom = 450/300	1.5
Single Family Building: Increase FF by <u>0.25</u> for each additional bedroom beyond three (3).	
Multi-Family Buildings, Residential Outbuildings, and Internal/Attached Accessory Apartments: Increase FF by <u>0.42</u> for each additional bedroom beyond 3.	
Non-Residential Buildings	
For non-residential buildings, the Flow Factor (FF) is calculated by: Design Flow (GPD) / 300	

Percolation Factors (PF)

Percolation Rate	Percolation Factor (PF)
Up to 10.0 Minutes/Inch	1.0
10.1 to 20.0 Minutes/Inch	1.25
20.1 to 30.0 Minutes/Inch	1.5
30.1 to 45.0 Minutes/Inch	3.0, or 2.0*
45.1 to 60.0 Minutes/Inch	5.0, or 3.0*

*If leaching system is entirely in select fill and the bottom of system is above original grade and at least 24 inches above maximum groundwater.

14. Nitrogen

14.1 General

Any nitrogen assessment required by PHC sections 19-13-B103d(d)(3)(F) and 19-13-B100a shall be conducted in compliance with this section.

14.2 Nitrogen Sensitive Areas

Nitrogen sensitive areas are defined in PHC section 19-13-B103. When an existing or proposed SSDS is located on a property requiring a nitrogen assessment in a nitrogen sensitive area and there are other systems on the property not located in the nitrogen sensitive area, all the systems on the property shall be evaluated using the Nitrogen Dilution Model per section 14.3.2.

14.3 Nitrogen Assessment

This subsection outlines the acceptable methods for nitrogen assessment. A compliant sewage effluent nitrogen concentration shall be no greater than 10 mg/l.

14.3.1 Simplified Nitrogen Dilution Model

The simplified nitrogen dilution model shall be based on the following criteria: size of the lot (square feet), average annual precipitation in Connecticut and average daily cumulative sewage design flow (gpd). For non-residential building(s), the average daily cumulative sewage design flow shall be determined by using water meter readings (minimum 1 year; not including a 1.5 factor of safety), or from Table 4 sewage design flows divided by 1.5.

Average daily cumulative design flows for a residential building(s) on a lot shall be based on $\frac{2}{3}$ of the daily design flow determined in section 7.1:

- 100 GPD per bedroom for the first 3 bedrooms.
- 50 GPD per bedroom beyond the first 3 bedrooms for a single-family residential building.
- 83.3 GPD per bedroom beyond the first 3 bedrooms, for multi-family residential building(s), including bedrooms in separate multi-family residential buildings, residential outbuildings, and internal or attached accessory apartments.

The development of a property beyond 1635 gpd per acre development density is considered non-compliant for the simplified nitrogen dilution model. This development density assumes: 60% of the total nitrogen will be treated by dilution, 60% precipitation infiltration, 40 mg/l nitrogen concentration in the wastewater, and annual precipitation of 48 inches.

14.3.2 Nitrogen Dilution Model

The Nitrogen Dilution Model shall be based on the requirements in Section X of Subsurface Wastewater Absorption System Design, Subsection G. Nutrient Reduction (Nitrogen and Phosphorus) of the Connecticut Department of Energy and Environmental Protection's "Guidance for Design of Large-Scale On-site Wastewater Renovation Systems" pages 41-48.¹

15. Groundwater and Surface Water Drainage

15.1 Storm Water

Storm water swales shall be constructed to lead storm water away from SSDSs. Minimum required separating distances between storm water collection, drainage, and infiltration systems and SSDSs are set forth in Table 1

¹ Jacobson, N.L. (February 2006). Guidance for Design of Large-Scale On-site Wastewater Renovation Systems. Connecticut Department of Energy and Environmental Protection, Bureau of Materials Management and Compliance Assurance. Hartford, CT. Available online at: https://portal.ct.gov/-/media/deep/water_regulating_and_discharges/subsurface/2006designmanual/completesec10pdf.pdf?rev=1ba5ff1b98ca45fbb53ce0a37abd3e71&hash=9DCAD418F0AD0C9B4AC8BD0CE8977383

(Item E, F and H). See section 5.3 for SSDS separating distance considerations for SWISs. Refer to section 6.5 and Table 3 for storm water drainage piping requirements.

Storm water that runs off an impervious cover and discharges via sheet flow or through minor leak-offs is not considered a drainage system. Pervious pavement material is not considered a SWIS. SWISs shall not concentrate large quantities of water in close proximity of SSDS as this may create localized groundwater mounding that may interfere with the operation of the SSDS and diminish wastewater renovation. See section 5 for additional storm water system separation distance requirements.

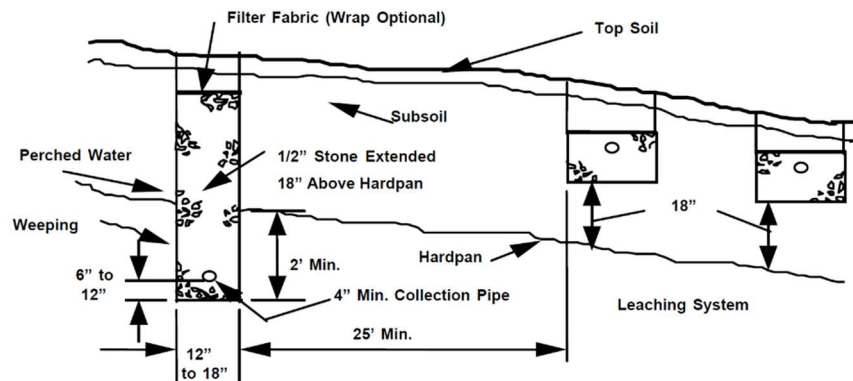


Figure 16. Typical Curtain Drain Construction

15.2 Groundwater Control Drains

Groundwater control drains, when utilized, shall be located up-gradient of the leaching system, and on the sides of the leaching system if necessary. The depth of these drains shall be designed to lower the groundwater at least 24 inches or 2 feet below the bottom of the entire leaching system (Figure 16). Drains shall be equipped with a collection pipe located 6 to 12 inches above the bottom of the trench to collect and discharge groundwater away from the leaching system area. This collection pipe shall have a minimum diameter of 4 inches and shall consist of open-joint tile, porous or perforated pipe. Perforated collection pipes shall be installed with holes on the bottom of the pipe and surrounded by clean stone or gravel to a depth necessary to control groundwater. Groundwater control drains shall be designed as indicated in Figure 16, or as otherwise designed by a P.E.

Minimum separation distances for all groundwater drainage systems (e.g., curtain, foundation) to a SSDS are set forth in Table 1 items E and G. An SSDS groundwater control system does not need to meet the other setback distances prescribed in Table 1. Groundwater drainage shall not discharge into or within 25 feet of a SSDS, and increased separation distance may be needed if the discharge location may impact the operation of the leaching system.

16. Water Treatment Wastewater

16.1 General Standards

All WTW disposal systems shall prevent the discharge of WTW to the ground surface, wetlands, or open watercourse, and shall comply with PHC section 19-13-B103g and the requirements outlined in the following subsection (section 16.2). The DOH may require an inspection of the WTW disposal system. In areas where well water treatment is anticipated, plans for new SSDSs shall designate an area where a WTW dispersal system may be installed in accordance with Table 9. WTWs approved by the commissioner to discharge to a SSDS are listed in Appendix D.

16.2 WTW Requirements

1. Certain water treatment systems, including but not limited to, whole house or building reverse osmosis systems, may produce very large quantities of WTW that may require significant area for a WTW dispersal system, and in these cases the DOH may choose to require a PHC 19-13-B100a(e) review, pursuant to PHC 19-13-B103g(e), to ensure preservation of SSDS areas.
2. WTW solid conveyance piping shall have a minimum separating distance of 25 feet, 75 feet, and 100 feet, respectively, to public and private water supply wells with required withdrawal rates of <10 GPM, 10 to 50 GPM, and >50 GPM. The DOH may further reduce the distance to not less than 10 feet to private wells on existing developed properties if compliance cannot be met due to site limitations. WTW solid conveyance pipe shall be approved by the DOH and protected from freezing. Solid pipe listed in Table 2-A is acceptable for gravity WTW conveyance pipe, and pipe listed in Table 2-B is acceptable for pressure WTW conveyance pipe.
3. Non-discharging WTW disposal system components, including but not limited to, WTW holding tanks, WTW dispersal system settling or filtration structures, shall meet the minimum separation distances cited in Table 9, unless otherwise authorized by the Commissioner in the commissioner's approval of the relevant WTW treatment or technology pursuant to PHC 19-13-B103g(b).
4. WTW dispersal systems shall meet the separation distances cited in Table 1, Item Q, and WTW dispersal system receiving structures shall meet the minimum separation distances cited in Table 9. Air gaps and breaks in WTW conveyance pipes that are outside of the building foundation shall meet the minimum separation distances cited in Table 9, unless otherwise authorized by the Commissioner, in the commissioner's approval of the relevant WTW treatment or technology pursuant to PHC 19-13-B103g(b).
5. WTW holding tanks, including piping, shall be located at least 10 feet from SSDSs.
6. WTW dispersal systems and WTW holding tanks shall be H-20 load rated in vehicular travel areas.
7. The bottom of the WTW dispersal system shall be located a minimum 12 inches above maximum groundwater and 24 inches above ledge rock.
8. WTW dispersal systems shall have a minimum storage volume of 1.5 times of either the anticipated discharge per cycle or daily average, whichever is greater.
9. Stone aggregate used shall be free of silt, dirt and debris and covered with approved filter fabric.
10. WTW holding tanks shall provide an access cleanout to grade and be equipped with a high-level alarm.
11. The DOH or registered environmental health specialist licensed pursuant to Chapter 395 may approve the design of a WTW dispersal system or WTW holding tank prior to installation. Approval is not required from the Commissioner for WTW holding tanks; however, approval from the Commissioner is required for any sewage holding tank to receive WTW discharges. (See section 17.7).
12. The installer shall provide 24-hour minimum notice to the DOH prior to commencement of installation, unless otherwise approved by the DOH as part of the DOH approval of the WTW system.
13. An as-built drawing shall be submitted to the DOH that includes distances from 2 or more permanent reference points to the WTW disposal system.

Table 9. Water Treatment Wastewater Dispersal System Separation Distance Requirements

Item	Separation Distance (Feet)	Special Provisions
Public or private water supply well with required withdrawal rate of: < 10 GPM 10 – 50 GPM > 50 GPM	75 150 200	The DOH may allow certain separation distance reductions on existing developed properties if compliance cannot be met due to site limitations. ⁽¹⁾⁽²⁾⁽³⁾
Open Watercourse	25	
Public Water Supply Reservoir	100	
Building	5	
Property Line	10	
Subsurface Sewage Disposal System	See Table 1, Item Q	
(1) Reductions shall not be granted to public water supply reservoirs or public water supply wells. (2) Reductions to private wells shall not be reduced to less than 25 feet. WTW discharges less than 75 feet up-gradient of a private well shall be avoided, whenever possible. (3) The DOH shall not allow reduced setback distances if there is a concern that the WTW may negatively impact the quality of the groundwater.		

17. Non-Discharging Toilets and Sewage Disposal Systems

17.1 Composting Toilets

All waste removed from composting toilets shall be disposed of by methods approved by the DOH upon application. Composting toilets shall be commercially manufactured and installed in accordance with the manufacturer's specifications.

Large capacity composting toilets with an interior volume of 64 cubic feet or greater shall have separate receiving, composting and storage compartments, arranged so that the contents are moved from 1 compartment to another without spillage, or escape of odors within the building. All toilet waste shall be deposited in the receiving chamber, which shall be furnished with a tight self-closing toilet lid. Food waste or other materials necessary to the composting action shall be deposited in the composting compartment through a separate opening with a tight-fitting lid. The final composting material shall be removed from the storage compartment through a cleanout opening fitted with a tight door or lid. The cleanout shall not be in a food storage or preparation area. The receiving and composting compartments shall be connected to the outside atmosphere by a screened vent. The vent diameter shall be a minimum of 6 inches and extend at least 20 feet above the openings in the receiving and composting compartments unless mechanical ventilation is provided. Air inlets shall be connected to the storage compartment only and shall be screened.

17.2 Heat-Assisted Composting Toilets

Heat assisted composting toilets shall have a single compartment furnished with a tight, self-closing toilet lid. The compartment shall be connected to the outside atmosphere by a screened vent. There shall be a mechanical ventilation fan arranged to control the humidity in the compartment and continuously provide positive venting of odors to the outside. A heating unit shall be provided to maintain temperature in the optimum range for composting.

17.3 Incineration Toilets

Gas-fired, oil-fired or electrical incineration toilets shall meet applicable fire and building codes. No ignition or incineration shall occur unless the toilet lid is closed or the toilet has a combustion chamber that is separate from the collection bowl, and the blower shall operate continuously during incineration. A combustion temperature of 1,000° Fahrenheit or higher shall be maintained during incineration.

17.4 Chemical Flush Toilets

Chemical flush toilets shall have toilet bowls that shall be flushed, when required, with chemicals or chemical solutions in accordance with the manufacturer's specifications. All liquid shall be discharged to a holding tank for removal of solids by settlement or other means prior to re-circulation for reuse in the toilet. The toilet bowl shall be trapped or otherwise constructed to exclude odors, and the toilet's holding tank shall be vented to the outside atmosphere. The toilet's holding tank shall be emptied or additional chemicals added when odors or other objectionable conditions occur.

17.5 Dry Vault Privies (Outhouses)

Dry vault privies shall be constructed with adequate storage space for excreta, and a fly-tight vault with a screened vent to the outside atmosphere. Self-closing, fly tight doors shall be provided. Dry vault privies shall be constructed to facilitate ease of cleaning. Separating distances shall comply with Table 1, and the bottom of earthen vaults shall be at least 18 inches above maximum groundwater and 4 feet above ledge rock.

17.6 Chemical Privies (Port-o-Potties)

Chemical privies shall be constructed with a watertight vault with a screened vent to the outside atmosphere. Self-closing, fly tight doors shall be provided. Separating distances shall comply with Table 1. The vault shall be emptied, or additional chemicals added, when odors or other objectionable conditions occur.

17.7 Sewage Holding Tanks

Pursuant to PHC sections 19-13-B103f(a) and 19-13-B103f(f), the Commissioner may approve sewage holding tanks for buildings governed by PHC sections 19-13-B103a through 19-13-B103f, inclusive. Sewage holding tanks shall comply with the separating distances cited in Table 1, unless an exception is granted pursuant to PHC section 19-13-B103d(a). Sewage holding tanks are prohibited for new residential lots and for increase in design flow on existing developed properties. Sewage holding tanks shall include cleanout manholes to grade to facilitate routine pumping and be provided with a high-level indicator alarm. The high-level alarm shall be set at $\frac{2}{3}$ the capacity of the holding tank. The alarm shall be both audible and visual, unless otherwise approved by the DOH, and be located so that it readily alerts building occupants when activated. The holding tank shall have sufficient liquid storage capacity to hold the volume of sewage expected to be discharged from the building over the period of a week or more.

Cleanout manhole covers shall weigh a minimum of 59 lbs., or the cover shall be provided with a lock system to prevent unauthorized entrance. Tank covers shall be left on the tank for safety reasons and to avoid potential odor problems when manhole riser assemblies are utilized over cleanout openings. If a riser cover weighs less than 100 lbs., then the tank cover shall remain in place or a secondary safety lid or device, installed in accordance with the manufacturer specifications, shall be provided. Secondary safety lids or devices shall be utilized for safety reasons even if the riser cover weighs 100 lbs. or greater.

Appendices

Appendix A. Approved Septic Tank Effluent Filters

Manufacturer	Model(s)
BEAR Onsite	ML2-416, ML2-920, ML3-910, ML3-916, ML3-925, ML3-932
Bio-Microbics	(SANITEE Series) ST 416, ST 418, ST 818, ST 838, ST 1618, ST 1638
BOWCO Industries	EF-235
GAG-Simtech	STF-110, STF-110-7R, STF-110-6W, STF-110-8B
NORWECO	BIO-KINETIC BK2000
ORENCO Systems	FT0444-36, FT0854-36, FT1254-36, FT1554-36, FTJ0418 PSCS0621-18, PSCW0621-18, PSCPS0621-18, PSCPW0621-18
Polylok	PL-68, PL-122, PL-250, PL-525, PL-625, GF10-8, GF10-16
Premier Tech	EFT-080
Rissy Plastics	45 – CLIK N' STICK
TUF-Tite	EF-4, EF-6
Zabel	A100, A300, A1800, A1801, A100-HIP, A300-HIP A1800-HIP, A1801-HIP, A600-12, A600-8
Zoeller/Claruss	WW1 (170-0078), WW4 (5000-0007)

Appendix B. Approved Filter Fabric for Covering Stone Aggregate

Manufacturer/Distributor	Designation Number
American Engineering Fabrics	AEF-480
Bradley Industrial Textile	Phoenix Lijoma
Carthage Mills	M35
Cultec	410
DuPont	SF20
Engineered Synthetic Products	TNS R020
Geo Fabrics	GF 150
L&M Supply Company	L&M 231
Mirafi	65304 (4' Wide) 65303 (3' Wide)
Mutual Industries	NW150SP
Skaps Industries	Skaps GT 120
SRW Products	SRW Products DF1.5 SRW Products DF2
Terra Tex	S01.5 P01.5
Typar	3151 3201
US Fabric, Inc.	US 1.5 CT

Appendix C. Approved Non-Concrete Septic Tanks

Manufacturer	Designation (ID Number)	Gallons
AK Industries, INC *Not approved for use as a pump chamber.	AKS60407*	1000
	AKS60407-HVY	1000
	AKS50807*	1050
	AKS50807-HVY	1050
	AKS80507*	1300
	AKS80507-HVY	1300
	AKS95207*	1500
	AKS95207-HVY	1500
Den Hartog Industries (Ace Roto-Mold)	AST 1000-2	1000
	AST 1250-2	1250
	AST 1500-2	1500
Infiltrator Water Technologies	IM-1060	1070
	IM-1250	1271
	IM-1530	1512
	CM-1060	1071
NORWESCO Standard Tank (STD) Bruiser Tank (BSR)	STD 1000	1000
	STD 1250	1250
	STD 1500	1500
	BSR 1000	1000
	BSR 1250	1250
	BSR 1500	1500
NORWESCO/Snyder (Dual Marked Tanks)	CT 1000 LP	1000
	CT 1250 LP	1250
	CT 1500 LP	1500
Roth Global Plastics Roth Multi-Tank Model (RMT)	RTM-500	500
	RTM-750	750
	RMT-1000E	1000
	RMT-1060	1060
	RMT-1250	1250
	RMT-1500	1500
Snyder Industries Note: Plumbed tanks are provided with inlet and outlet piping, whereas unplumbed tanks are not.	Dominator Tanks (Plumbed)	
	1001010W95314	1000
	1001411W95304	1250
	1001511W95303	1500
	Dominator Tanks (Unplumbed)	
	1001010W95306	1000
	1001411W95306	1250
	1001511W95307	1500
Valencia Pipe Company (VPC)	One (1) Compartment Tanks	
	87-41718	1000
	87-41758	1500
	Two (2) Compartment Tanks	
	87-41720	1000
	87-41760	1500

Appendix D. Water Treatment Wastewater Discharges to SSDSs

<u>Authorized WTW Sources</u> WTW shall only be from a calcite filter, granular activated carbon filter, a Point of Use (POU) reverse osmosis unit or heavy-metal adsorption media.
<u>WTW Discharge Limits</u> Single-family residential buildings: WTW discharge is less than 150 gallons per backwash cycle and shall not exceed a daily average of 50 GPD. Other buildings: WTW discharge is less than 150 gallons per backwash cycle or less than 10% of the building's SSDS daily design flow, whichever is greater. Additionally, discharges shall not exceed a daily average of 50 GPD or 2% of the buildings SSDS daily design flow, whichever is greater.
<u>Existing SSDS Requirements</u> Septic tanks must have 2 compartments, an effluent filter, and be properly sized for the daily design flow of the building. Single compartment tanks may remain only if receiving WTW from a POU reverse osmosis unit that discharges less than 50 GPD. Septic tanks must have been cleaned and inspected within 3 years with no reported signs of malfunctioning. Leaching systems must provide at least 50% of the required ELA and be in good operating condition with no signs of malfunction or be at risk of hydraulically overloading the receiving soil.
<u>Proprietary Leaching Systems</u> Proprietary leaching system companies may not support the discharge of WTW into their SSDS products. Therefore, the applicant shall consult with the proprietary company to determine if use of their leaching system product is suitable with WTW discharge.